

2026

Ontario Hybrid Corn Performance Trials


Data collected 2025-2026

Conducted by the Ontario Corn Committee • www.Corn.GoCrops.ca

Go to www.Corn.GoCrops.ca

PDF files of this report
Sortable on-line tables
Yield x Moisture Content

Average Accumulated CHU 1971-2000 May 1st Start

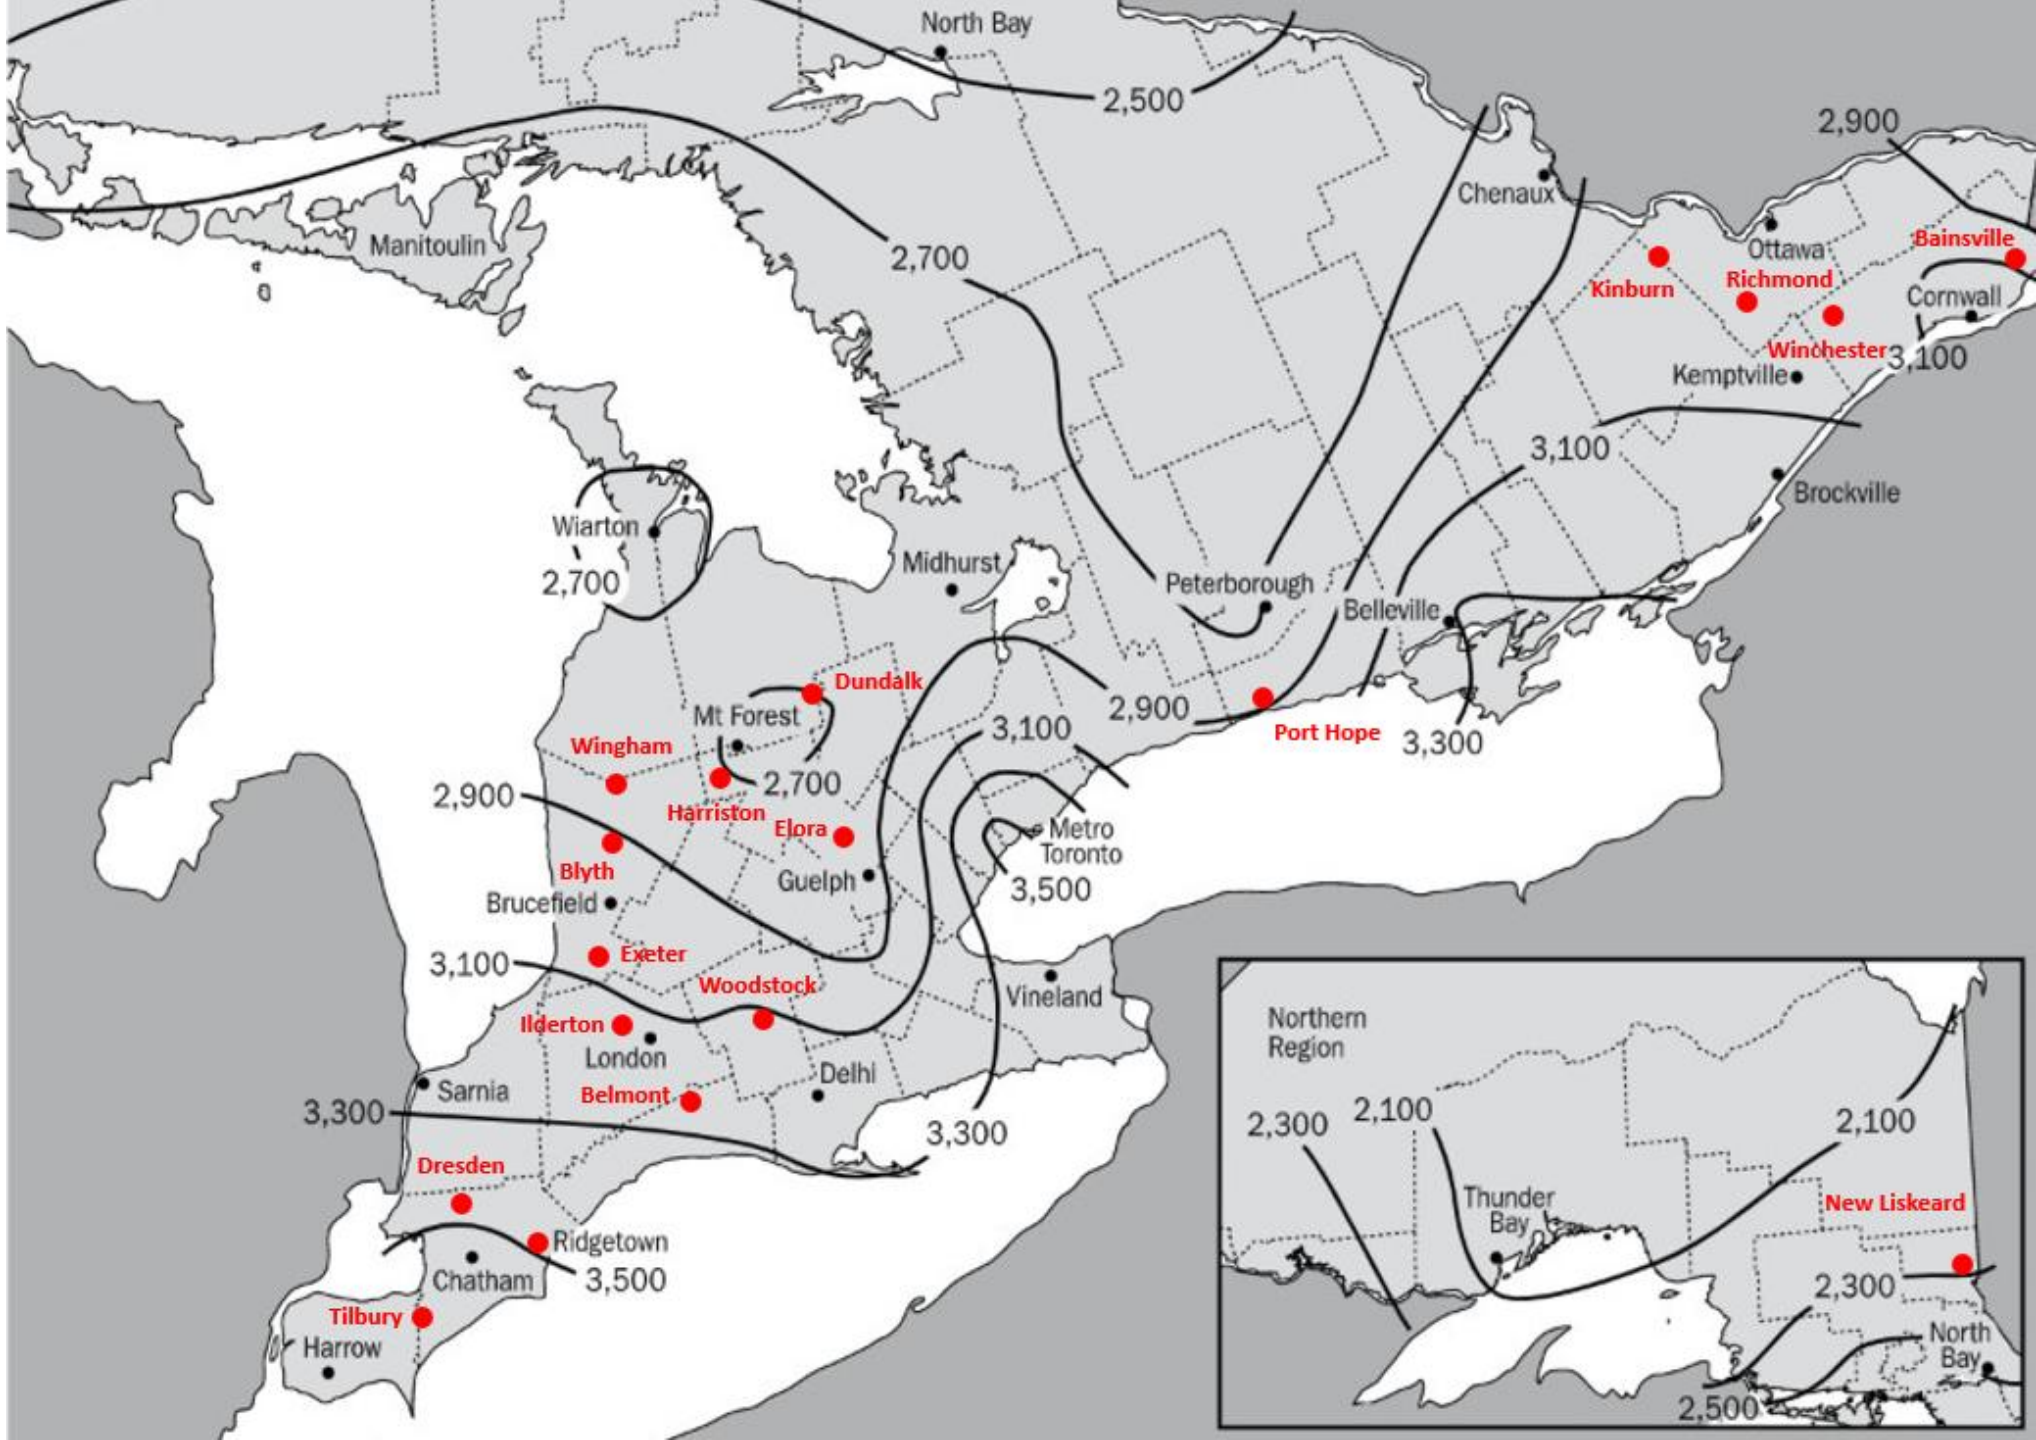

ONTARIO CORN COMMITTEE

The ONTARIO CORN COMMITTEE is made up of representatives of Agriculture and Agri-Food Canada, the Ontario Ministry of Agriculture, Food and Rural Affairs, the University of Guelph, the Ontario Soil and Crop Improvement Association, the Grain Farmers of Ontario and the Canadian Seed Trade Association.
Hybrid Performance trials are conducted each year by the following cooperating agencies:
Ridgetown Campus, University of Guelph;
Plant Agriculture Department, University of Guelph;
Winchester Research Station, University of Guelph,
Kent Ag Research Inc.

TESTING METHODS
Hybrids entered in the Hybrid Corn Performance Trials are selected by the seed companies. A testing fee is charged per hybrid per replication. A hybrid must be entered in all trials within a table.
In each trial, hybrids are replicated in a suitable experimental design. Trials are machine planted with an excess of seed and thinned at an early growth stage to obtain a uniform population. A row width of 30 inches is used in all trials. Plots consist of four rows of which the middle two rows are harvested for yield. Fertilizer rates may be higher than those recommended by OMAFA to compensate for any variability in soil nutrient supply.

Most of the hybrids entered in the trials were treated with a seed treatment to control soil insects. Hybrids that were not treated with are not identified in the report. There was no significant damage from soil insects at any of the locations.

To determine the percentage of lodged plant, a count is made, immediately before harvest, of all plants broken below the ear and all plants which are leaning such that the ear is in the adjacent row or is otherwise unharvestable.

The moisture percentage of the grain is measured at harvest time. The weight of grain harvested from each plot is determined and the yield of shelled corn is calculated at 15% moisture. Test weights are recorded either during harvest, using combine-mounted monitoring equipment, or in the laboratory, using accepted procedures.

DUPLICATION OF THIS REPORT:
This report may be reproduced in its entirety provided that due credit is given to the Ontario Corn Committee and provided that neither the content nor the appearance of the report is altered. Tables may be reproduced provided that the entire table, with accompanying notes, is included. Data from the OCC Performance Trials used for any further analysis or other purposes must first get authorization from the Ontario Corn Committee.
For further information, contact
The Secretary, Ontario Corn Committee,
107 Templeton Court
Kemptville, ON K0G 1J0
eastcropper@gmail.com

2026 Ontario Hybrid Corn Performance Trial Management Information

Location	Table	Previous Crop	Tillage		Soil Test Ratings			Fertilizer Applications				Pesticide Applications					Rainfall (mm)					
			Fall	Spring	P	K	pH	N	P2O5	K2O	S	Type	Product	Rate	Date	Method/ Crop Stage	May	Jun	Jul	Aug	Sep	Yr
New Liskeard	0	Spring Wheat	Salford 5200 Discs	Salford 5200 Discs	MR	RR	7	197	64	32	24	Herbicide	Roundup Transorb HC	3.33 l/ha	Jul 03	POST	46	98	47	108	16	315
Harriston	1	Soybeans	Chisel Plow	Cultivator 2x	MR	HR	7	180	60	80		Herbicide Herbicide Herbicide	Acuron Pardner Engenia	2 L/ac 0.2L/ac 0.1L/ac	May 29 May 30 May 30	POST POST POST	57	105	39	122	6	329
Dundalk	1	Soybeans	None	Vertical Till 2x	MR	MR	7	180	60	80		Herbicide Herbicide Herbicide	Laudis Aatrex Xtendimax	88mL/ac 1.2L/ac 820mL/ax	Jun 04 Jun 04 Jun 04	POST POST POST	68	133	118	151	26	496
Port Hope T2	2	Soybeans	None	Vertical Till 2x	MR	MR	7	180	60	80		Herbicide	Acuron	2 L/ac	May 22	POST	91	103	128	198	40	560
Elora	2	Soybean	Disk	Cultivator	LR	MR	7	180	130	140	10	Herbicide	Acuron	4.9 L/ha	May 29	POST	68	131	47	121	33	400
Wingham	2	Wheat		Cultivate 2x	RR	RR	7	201	11	3	22	Herbicide	Integrity	450 mL/ac	May 01	PPI	58	90	60	105		N/A
Kinburn	2	Soybean		Disc, Cultivator	RR	RR	6	180	90	33	30	Herbicide	Acuron	2 L/ac	May 29	POST	39	138	237	145	67	626
Richmond	3E	Soybean	Chisel Plow	Cultivator 2x	LR	MR	6	180	150	90	40	Herbicide	Acuron	2 L/ac	Jun 02	POST	46	136	190	114	48	534
Winchester	3E	Soybean	Chisel Plough	Cultivator 2x	LR	LR	5	180	90	33	30	Herbicide Herbicide Herbicide	Acuron Dual II Magnum Acuron	2 L/ac 0.7 L/ac 1.5 L/ac	Jun 02 May 07 Jun 05	 PPI POST	56	107	143	135	77	518
Bainsville	3E	Soybeans	Chisel Plow	Cultivator 2x	MR	MR	6	180	60	80		Herbicide	Acuron	2 L/ac	May 22	POST	58	139	151	99	77	524
Port Hope	3W	Soybeans	None	Vertical Till 2x	MR	MR	7	180	60	80		Herbicide	Acuron	2 L/ac	May 22	POST	91	103	128	198	40	560
Blyth	3W	Wheat	Strip Till	Strip Till Refresh	NR	NR	7	175	12	3	25	Herbicide Herbicide	Roundup Integrity	1.0 L/ac 0.3 L/ac	May 05 May 05		55	110	70	160		N/A
Woodstock 3W	3W	Soybeans	None	Strip Till	MR	MR	6	180	60	80		Herbicide Fungicide Fungicide	Corvus Delaro Complete Proline	164mL/ac 356mL/ac 38mL/ac	May 11 Jul 30 Jul 30	PRE VT VT	65	74	82	180	27	428
Ilderton	4			Cultivation	MR	RR	8	200	11	3	1	Herbicide	Acuron	1.96 L/ac	Jun 08	POST	49	95	35	125	60	364
Belmont	4	Soybean	High Speed Disk	Cultivate	MR	MR	7	228	12	3	1	Herbicide Fungicide	Acuron Delaro Complete	1.96 Liters/acre 237ml/acre	Jun 10 Aug 03	POST R1	104	104	51	92	59	410
Woodstock	4	Soybeans	None	Strip Till	MR	MR	6	180	60	80		Herbicide Fungicide Fungicide	Corvus Delaro Complete Proline	164mL/ac 356mL/ac 38mL/ac	May 11 Jul 30 Jul 30	PRE VT VT	65	74	82	180	27	428
Exeter	4	Wheat		HS Disk	MR	RR	7		11	3		Herbicide Herbicide	Frontier Max Acuron	 1.96 L/ac	 Jun 08	PPI POST	30	105	35	150	60	380
Ridgetown	5	Soybeans	Chisel Plow	Cultivate	LR	RR	7	224	12	3	1	Herbicide Fungicide Fungicide	Acuron Veltyma Caramba	1.96 Liters/acre 0.8 L/ac 1.6 L/ac	May 26 Jul 31 Jul 31	POST R1 R1	59	124	29	118	59	389
Dresden	5	Soybeans	Chisel Plow	Cultivate	HR	RR	7	224	12	3	1	Herbicide Fungicide Fungicide	Acuron Veltyma Caramba	1.96 Liters/acre 0.8 L/ac 1.6 L/ac	May 27 Jul 31 Jul 31	POST R1 R1	43	64	40	71	39	257
Tilbury	5	Soybean	Chisel Plow	Cultivate	LR	RR	6	224	12	3	1	Herbicide Fungicide	Acuron Delaro Complete	1.96 Liters/acr 237ml/acre	Jun 11 Aug 07	POST R1	82	57	44	93	60	336

Notes:
Herbicide Application Timings (from Pub 75): PP - Preplant, PPI - Preplant Incorporated, PRE - Preemergence, POST - Postemergence.
Fungicide Application Timings: LV - Late Vegetative, VT - Tassel, R1 - Silking, R2 - Blister, R3 - Milk.

INTERPRETATION OF RESULTS

Index - The index in the tables indicates a percent of the average of all hybrids included in the trial(s). Index figures above 100 reflect the percentage by which a hybrid is above the average, and index figures below 100 show the percent below average. Small differences in index (i.e. less than the LSD shown at the bottom of the table) are not significant. When a hybrid has a higher index over two years, this difference is probably real and should be considered when choosing a hybrid.

Hybrid selection should be based on the most data available. Greater emphasis should be put on averages from several locations and years because these provide a more accurate prediction of future performance than do single location results.

The average yield for each table is given in bushels per acre. You can calculate the actual yield for a hybrid by multiplying the average yield times its yield index and dividing by 100.

The average test weight is given in kg/h1 (kilograms per hectoliter). You can calculate the actual test weight of a hybrid by multiplying the average test weight times its test weight index and dividing by 100.

Within each table, hybrids are identified by brand and/or hybrid number or name. Hybrids are listed in approximate order of maturity based on heat unit ratings provided by the companies.

Corn Heat Units - Ratings for all areas of the province are based on the average heat unit accumulation for the period from May 1 to the date in the fall when the long-term average daily temperature falls below 12° C or an occurrence of -2° C, whichever comes first. Hybrid heat unit ratings have been assigned by the sponsoring company.

% Moisture - The accuracy of moisture measurement decreases as moisture content increases. Results for hybrids with very high moisture contents should be interpreted with caution.

% Lodging - "Lodged Plants" includes plants with stalks that are broken below the ear and plants leaning such that the ear is in the adjacent row or otherwise unharvestable. Because all hybrids in a trial are harvested on the same date, the early hybrids within each table tend to show a greater amount of stalk breakage than do later hybrids. Stalk strength should be compared only with hybrids of the same maturity.

LSD (0.10) - The LSD is a measure of variability within the trial. There is a ninety percent probability that yield indices that differ by an amount greater than the LSD are different. Yield indices that differ by an amount less than or equal to the LSD should be considered to be equal. For example, if the LSD is 10, two hybrids with yield indexes of 110 and 101 should be considered to be equal.

Explanation Of Codes For Special Genetic Traits

Code	GM Traits
0	Conventional Hybrid
4	Roundup Ready Corn 2
6	VT Double PRO
8	SmartStax
14	Agrisure GT
20	Agrisure Viptera 3111
24	Optimum AcreMax Xtreme
25	Optimum AcreMax Xtra
27	Viptera
28	Agrisure Above
30	PowerCore Enlist
31	SmartStax Enlist
32	Trecepta
33	Duracade
34	DuracadeViptera
36	Qrome
37	Optimum AcreMax Leptra
38	SmartStax PRO
39	VT4PRO
40	Vorceed Enlist

Explanation Of Seed Treatment Codes

-	No Treatment
A	Acceleron 250
C	Cruiser Maxx 250
F	Fortenza
L	Lumivia
P	Poncho 250
AD	Acceleron Standard Diamide
V	Vibrance® Cinco

Notes:

The Ontario Corn Committee does not assess hybrids for Special Genetic Traits. Hybrid descriptions are based on information received from corn companies, as of November 2026. Although the Ontario Corn Committee believes the information contained in this report is accurate, growers are advised to consult dealers of the respective hybrids and products before making purchasing or management decisions. All hybrids included in this report have been fully approved for food and feed use in Canada and the United States. However, a number have not been approved for use in the European Union. Corn harvested from these non-EU approved hybrids must be delivered to a market that will not ship the grain or its processed products to Europe. For more information, contact your seed supplier. Information regarding the genetic traits carried by all commercially available hybrids and their acceptability for export can also be obtained from the Seeds Canada's at: https://seeds-canada.ca/corn-hybrid-database/

Seed Corn Dealers

Brand or Identification	Company	Address of Canadian Sponsor	Telephone
CROPLAN	WinField United Canada	302 Wellman Lane #101, Saskatoon, SK S7T 0J1	613-872-3550
De Dell	De Dell Seeds Inc	7095 Century Drive, Melbourne, ON N0L 1T0	833-436-2676
DEKALB	DEKALB	2-679 Southgate Drive, Guelph, ON N1G 4S2	519-767-3366
DLF	DLF Canada Inc.	3043 County Road 2, Port Hope, ON L1A 3V5	1-705-878-9240
Horizon	Horizon Seeds Canada Inc.	729 Mid N. Walsingham Townline Rd, Courtland, ON N0J 1E0	519-8425538
Maizex	Maizex Seeds Inc.	4488 Mint Line, Tilbury, ON N0P 2L0	877-682-1720
NK Brand	Syngenta Canada, Inc. (NK)	140 Research Lane, Research Park, Guelph, ON N1G 4Z3	1-877-964-3682
Pioneer	Pioneer Hi-Bred Canada	12111 Mississauga Road, Caledon, ON L7C 1X1	ca.pioneer.com
PRIDE Seeds	PRIDE Seeds	PO Box 1088, 6836 Pain Court Line, Pain Court,ON, Chatham, ON N7	1-800-265-5280
Saatbau	Saatbau Canada inc	201, rue St Louis, 412, St Jean sur Richelieu, QC J3B 1X9	514-609-0881
Thunder Seed	Thunder Seed	P.O. Box 734, Carman, MB R0G 0J0	(204)872-0380

2026 Trial Locations and General Information - Ontario Hybrid Corn Performance Trials

Location:	See Table Number	Heat Unit Rating	5 Year Heat Unit Average [1]	2026 CHU Total [2]	Soil Type	Co-operator	Final plants per acre [3]	Date planted [4]	Date Harvested
New Liskeard	0	2200	N/A	2382	Clay	Ontario Crop Research Centre - New Liskeard	30000	May 30	Oct 30
Harriston	1	2700	N/A	2886	Loam	Max VonWesterholt	36000	May 16	Nov 13
Dundalk	1	2600	N/A	2618	Clay Loam	Blydorp Farms	36000	May 15	Nov 12
Port Hope T2	2	2800	N/A	3102	Sand Loam	Bruce Hendry	36000	May 12	Nov 09
Elora	2	2800	N/A	2829	Silt Loam	University of Guelph	34000	May 11	Oct 30
Wingham	2	2800	N/A	3010	Silt Loam	Rob Warwick	34000	May 15	Oct 28
Kinburn	2	3000	N/A	3012	loam	Panmure Farms	34000	May 08	Nov 04
Richmond	3E	3000	N/A	3112	loam	Fraser Farms	34000	May 08	
Winchester	3E	3000	N/A	3093	loam	Ontario Crops Research Centre - Winchester	34000	May 12	
Bainsville	3E	3000	N/A	3034	Clay Loam	Rob McDonald	36000	May 12	Nov 11
Port Hope	3W	3000	N/A	3102	Sand Loam	Bruce Hendry	36000	May 12	Nov 09
Blyth	3W	3000	N/A	3089	Silt Loam	Peter Heinrich	34000	May 15	Oct 29
Woodstock 3W	3W	3150	N/A	3242	Loam	Wes Hart	36000	May 09	Nov 14
Ilderton	4	3100	N/A	3134	Silt Loam	Steve Twynstra	34000	May 21	Nov 03
Belmont	4	3250	N/A	3101	Silt Clay	Claire Hooker Farms	34000	May 29	Nov 06
Woodstock	4	3150	N/A	3242	Loam	Wes Hart	36000	May 09	Nov 14
Exeter	4	3050	N/A	3118	Silt Loam	Cliff Hicks	34000	May 21	Nov 02
Ridgetown	5	3450	N/A	3378	Loam	University of Guelph-Ridgetown Campus	33000	May 09	Nov 10
Dresden	5	3600	N/A	3469	Sandy Loam	Brent McFadden	33000	May 11	Nov 09
Tilbury	5	3650	N/A	3303	Clay	Gus Ternoey	33000	Jun 01	Nov 10

Notes:

1 Average total heat unit accumulation 2021 - 2025, inclusive.

2 Total heat unit accumulation at location from day of planting to either occurrence of killing frost (-2 C) or 30-year average end-of-season date.

3 These populations may not be suitable for your farm.

4 All trials planted in 30 inch row widths.

Table 0: New Liskeard

2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 2 trials Yield Index	Moist[3] %	Ldg %	Test Wt Index	2026 averages[2] average of 1 trials Yield Index	Moist[3] %	Ldg %	Test Wt Index	Performance Trials NEW LISKEARD Yield Index	Moist[3] %	Ldg %
2000	Pioneer	P71231PCE	30	L					**108**			**104**	108		
2025	DEKALB	DKC069-10RIB	6	P					**113**			**109**	113		
2050	CROPLAN	CP1221VT2P	6	A					**102**			**110**	102		
2050	Maizex	MZ 1255DBR	6	F	**105**			**104**	**100**			**108**	100		
2075	DEKALB	DKC072-12RB	6	AD	**104**			**102**	**103**			**105**	103		
2075	DLF	DLF 2016VT2P RIB	6	AD					**97**			**103**	97		
2100	Maizex	MS6960R	4	F	**106**			**105**	**104**			**107**	104		
2100	Pioneer	P72068AM	25	L	**106**			**106**	**108**			**111**	108		
2125	PRIDE Seeds	A4226G2	6	F	**100**			**104**	**105**			**107**	105		
2150	DEKALB	DKC075-70RIB	6	AD	**104**			**104**	**104**			**107**	104		
2150	Maizex	MZ 1397DBR	6	F	**111**			**105**	**107**			**107**	107		
2150	Pioneer	P75303PCE	30	L					**110**			**103**	110		
2150	Pioneer	P7574AM	25	L	**101**			**98**	**104**			**101**	104		
2175	DEKALB	DKC077-26RIB	6	P					**90**			**99**	90		
2225	Thunder Seed	TH6278 VT2P	6	F					**89**			**91**	89		
2250	Maizex	MZ 1544DBR	6	F	**98**			**93**	**98**			**96**	98		
2250	Pioneer	P78150PCE	30	L					**106**			**89**	106		
2250	PRIDE Seeds	A4494G2 RIB	6	F	**101**			**98**	**98**			**101**	98		
2325	Thunder Seed	TH6780 PC	30	F					**99**			**85**	99		
2350	CROPLAN	CP2130VT2P	6	A					**94**			**89**	94		
2375	PRIDE Seeds	A4848G2 RIB	6	F	**93**			**92**	**96**			**92**	96		
2400	NK Brand	NK8005-V	27	F	**81**			**93**	**82**			**92**	82		
2400	PRIDE Seeds	A5175G2 RIB	6	F	**91**			**96**	**87**			**98**	87		
2400	Thunder Seed	TH6182 VT2P	6	F					**97**			**87**	97		
	LSD (0.10) for Yield Index Points*				**6**				**8**				8		
	Average all hybrids **				**113**			**62**	**119**			**63**	119		

[1] New Liskeard 2025-2026 [2] New Liskeard [3]Yields are adjusted to standard moisture.

* The LSD is a measure of variability within the trial. Yield indices that differ by an amount less than or equal to the LSD should be considered to be equal.

** Average Yields are shown in bushels per acre. Average Test Weights are shown in kg/hl.

Hybrid selection should be based on the most data available. Emphasis should be put on averages from several locations and years because these provide a more accurate prediction of future performance than do single location results.

Table 1: Harriston, Dundalk

2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 4 trials				2026 averages[2] average of 2 trials				Results of 2026 Performance Trials DUNDALK			Results of 2026 Performance Trials HARRISTON		
					Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %
2250	Maizex	MZ 1544DBR	6	F	**97**	**21.2**	**0**	**101**	**99**	**18.8**	**0**	**101**	100	20.1	0	97	17.4	0
2325	Thunder Seed	TH6780 PC	30	F					**99**	**19.4**	**0**	**101**	102	20.9	0	95	17.8	0
2350	CROPLAN	CP2130VT2P	6	A	**93**	**21.3**	**0**	**103**	**93**	**18.7**	**0**	**105**	94	20.0	0	93	17.4	0
2350	LIDS	LID0001	0	A	**92**	**21.3**	**1**	**101**	**84**	**19.0**	**0**	**101**	76	19.8	0	92	18.2	0
2400	Pioneer	P82288PCE	30	L	**100**	**21.1**	**0**	**101**	**100**	**19.1**	**0**	**103**	100	20.2	0	99	18.1	0
2400	Pioneer	P8294AM	25	L	**96**	**21.9**	**0**	**101**	**95**	**19.3**	**0**	**102**	100	20.4	0	89	18.2	0
2400	PRIDE Seeds	A5175G2 RIB	6	F	**96**	**21.9**	**0**	**102**	**95**	**19.5**	**0**	**102**	98	20.6	0	92	18.4	0
2400	Thunder Seed	TH6182 VT2P	6	F	**98**	**21.0**	**0**	**101**	**99**	**19.2**	**0**	**102**	97	20.4	0	101	18.0	0
2450	Maizex	MZ 2266DBR	6	F	**98**	**21.0**	**0**	**103**	**99**	**19.2**	**0**	**103**	102	20.2	0	96	18.2	0
2450	Saatbau	ARTEGO	0	C					**100**	**19.6**	**1**	**104**	102	20.6	0	99	18.6	1
2500	CROPLAN	CP2324VT2P	6	A	**103**	**21.3**	**0**	**100**	**104**	**19.6**	**0**	**100**	102	20.7	0	105	18.4	0
2500	Maizex	MZ 2344DBR	6	F	**98**	**21.1**	**0**	**103**	**96**	**18.6**	**0**	**104**	97	19.6	0	96	17.7	0
2500	Pioneer	P85199PCE	30	L					**100**	**20.0**	**0**	**102**	105	21.9	0	95	18.2	0
2525	De Dell	DL 1815	0	F	**95**	**22.2**	**0**	**103**	**93**	**19.9**	**0**	**104**	94	21.4	0	93	18.3	0
2525	Maizex	MZ 236	0	F					**100**	**19.7**	**0**	**102**	100	21.0	0	100	18.4	0
2550	Thunder Seed	TH6185 VT2P	6	F	**98**	**21.9**	**0**	**100**	**99**	**20.0**	**0**	**100**	99	21.2	0	100	18.8	0
2550	Thunder Seed	TH8785 SS	8	F					**100**	**20.2**	**0**	**101**	100	22.1	0	100	18.3	0
2575	DEKALB	DKC085-41RIB	38	P					**99**	**21.2**	**0**	**100**	99	23.6	0	100	18.9	0
2575	DEKALB	DKC35-29RIB	6	AD	**107**	**22.7**	**0**	**100**	**107**	**19.8**	**0**	**102**	109	21.1	0	105	18.4	0
2575	Maizex	MZ 2575DBR	6	F	**99**	**22.2**	**0**	**99**	**105**	**19.8**	**0**	**100**	105	20.8	0	105	18.8	0
2600	DEKALB	DKC36-48RIB	6	AD	**101**	**22.1**	**0**	**100**	**102**	**19.9**	**0**	**100**	101	21.1	0	104	18.6	0
2600	Horizon	HZ 2728	27	F					**102**	**20.6**	**0**	**98**	102	22.4	0	102	18.8	0
2600	Maizex	MZ 269	0	F	**102**	**23.1**	**0**	**101**	**100**	**19.8**	**0**	**102**	99	20.9	0	102	18.6	0
2600	Pioneer	P87040PCE	30	L	**100**	**23.0**	**0**	**100**	**101**	**20.2**	**0**	**101**	104	21.8	0	99	18.6	0
2600	Saatbau	FARMICO	0	C					**98**	**22.2**	**1**	**101**	98	23.6	0	99	20.9	1
2625	DLF	DLF 2640	0	AD	**104**	**22.1**	**0**	**102**	**105**	**20.1**	**0**	**103**	104	21.7	0	106	18.4	0
2625	DLF	DLF 2777RR	4	AD	**102**	**24.4**	**0**	**98**	**98**	**23.3**	**0**	**96**	97	26.3	0	99	20.4	0
2625	NK Brand	NK8558-AA	28	F	**102**	**23.9**	**0**	**97**	**93**	**21.2**	**0**	**98**	96	23.0	0	91	19.4	0
2625	PRIDE Seeds	A5292G8 RIB	8	F	**95**	**23.4**	**0**	**100**	**98**	**20.6**	**0**	**101**	98	22.4	0	98	18.8	0
2625	PRIDE Seeds	A5424G2 RIB	6	F	**92**	**24.2**	**0**	**99**	**97**	**21.0**	**0**	**100**	100	22.5	0	94	19.4	0

Table 1: Harriston, Dundalk

2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 4 trials Yield Index	Moist %	Ldg %	Test Wt Index	2026 averages[2] average of 2 trials Yield Index	Moist %	Ldg %	Test Wt Index	Results of 2026 Performance Trials DUNDALK Yield Index	Moist %	Ldg %	HARRISTON Yield Index	Moist %	Ldg %
2650	CROPLAN	CP2667VT2P	6	A					**101**	**21.4**	**0**	**99**	101	23.5	0	102	19.2	0
2650	LIDS	LID0002	0	A	**102**	**22.9**	**0**	**104**	**100**	**20.3**	**0**	**105**	97	21.6	0	103	18.9	0
2650	Maizex	MZ 2784SMX	8	F					**98**	**21.4**	**0**	**99**	99	23.8	0	97	19.1	0
2650	Pioneer	P91083PCE	30	L	**107**	**24.1**	**0**	**98**	**102**	**21.3**	**0**	**97**	102	22.8	0	103	19.7	0
2650	PRIDE Seeds	A5580G4	32	P					**98**	**20.4**	**1**	**103**	100	22.2	0	96	18.6	1
2675	Horizon	HZ 2910	28	F	**97**	**26.9**	**0**	**94**	**97**	**24.1**	**0**	**93**	95	26.5	0	99	21.6	0
2675	LIDS	LID0005	0	A					**103**	**21.3**	**0**	**98**	102	22.5	0	104	20.1	0
2675	Maizex	MZ 2803DBR	6	F					**104**	**21.5**	**0**	**99**	106	23.7	0	101	19.3	0
2675	NK Brand	NK8711-V	27	F	**99**	**23.9**	**0**	**99**	**99**	**21.3**	**0**	**98**	96	23.4	0	102	19.2	0
2675	NK Brand	NK8828-V	27	F					**100**	**20.8**	**0**	**97**	93	22.5	0	107	19.0	0
2700	De Dell	DL 3007	0	F					**96**	**22.2**	**0**	**100**	94	24.9	0	99	19.5	0
2700	DEKALB	DKC088-16RIB	6	P					**105**	**21.1**	**0**	**98**	104	22.4	0	107	19.9	0
2700	DEKALB	DKC089-53RIB	32	A	**109**	**23.6**	**0**	**100**	**111**	**21.5**	**0**	**100**	113	23.5	0	110	19.4	0
2700	Maizex	MZ 3006DBR	6	F					**111**	**22.2**	**0**	**96**	112	24.2	0	109	20.2	0
2700	Pioneer	P91719PCE	30	L					**101**	**23.1**	**0**	**98**	99	25.3	0	103	20.8	0
2725	DLF	DLF 2712GSX RIB	8	AD	**102**	**26.1**	**0**	**97**	**102**	**22.6**	**0**	**95**	104	25.4	0	101	19.9	0
2725	DLF	DLF 2767VT2P RIB	6	AD	**108**	**25.5**	**0**	**97**	**105**	**21.4**	**0**	**95**	105	23.1	0	106	19.7	0
2750	DEKALB	DKC091-11RIB	39	A	**106**	**26.7**	**0**	**96**	**105**	**22.9**	**0**	**95**	106	25.3	0	103	20.6	0
2750	Thunder Seed	TH6490 VT2P	6	F	**103**	**23.7**	**0**	**99**	**99**	**20.8**	**0**	**98**	97	22.5	0	102	19.0	0
	LSD (0.10) for Yield Index Points*				**4**				**5**				7			7		
	Average all hybrids **				**226**	**23.0**	**0**	**69**	**252**	**20.6**	**0**	**70**	250	22.3	0	254	19.0	0

[1] Dundalk 2025-2026, Harriston 2025-2026

[2] Dundalk, Harriston


* The LSD is a measure of variability within the trial. Yield indices that differ by an amount less than or equal to the LSD should be considered to be equal.

** Average Yields are shown in bushels per acre. Average Test Weights are shown in kg/hl.

Hybrid selection should be based on the most data available. Emphasis should be put on averages from several locations and years because these provide a more accurate prediction of future performance than do single location results.

Note: The accuracy of moisture measurement decreases as moisture content increases. This also affects the accuracy of yield determination. Results for hybrids with moisture contents over 30% should be interpreted with much caution.

OCC 1 Year Averages (2026) for Area 1: Harriston, Dundalk.

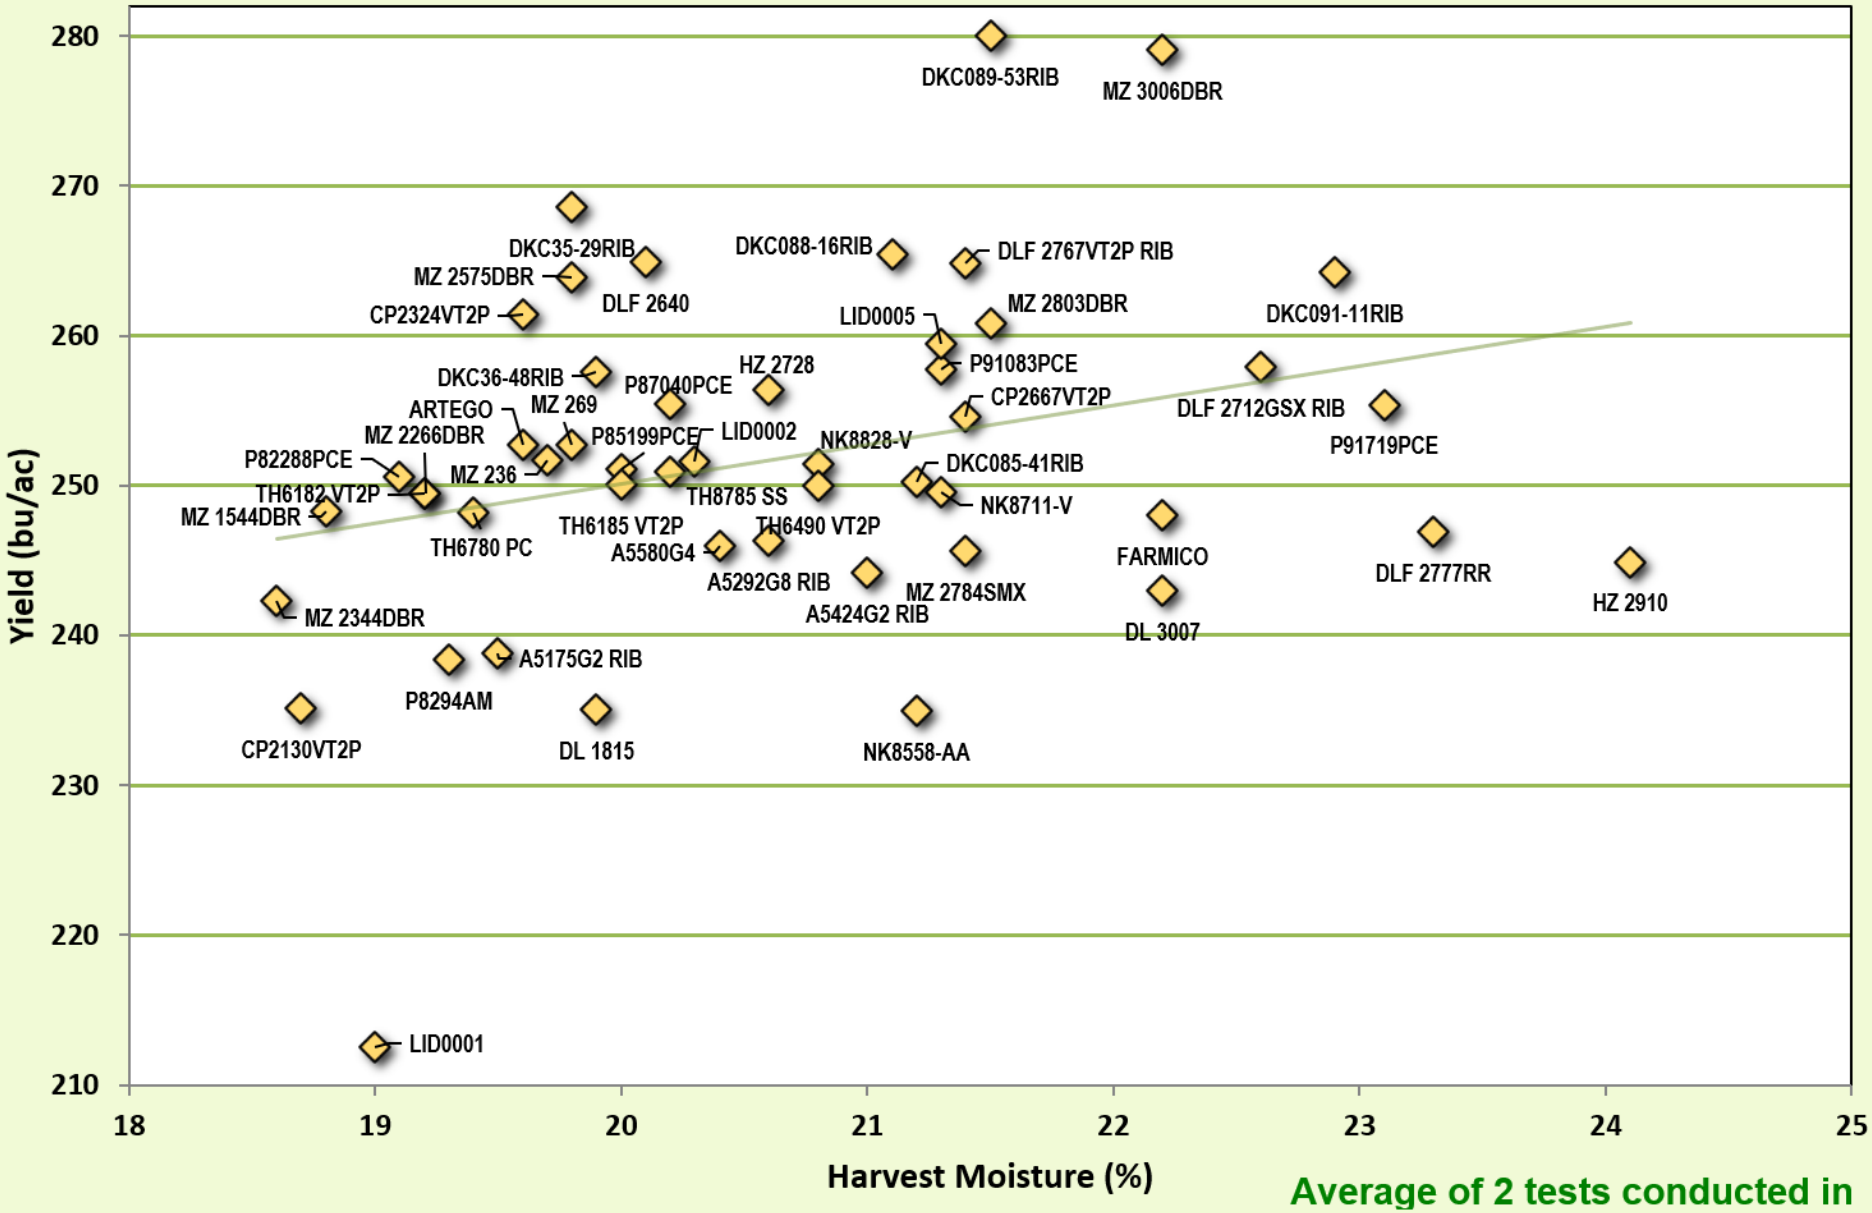


Average of 2 tests conducted in Harriston, Dundalk

©2026 Ontario Corn Committee

Please refer to Table 1 for hybrid brand and complete agronomic performance data.

OCC 2 Year Averages (2025-2026) for Area 1: Harriston, Dundalk.

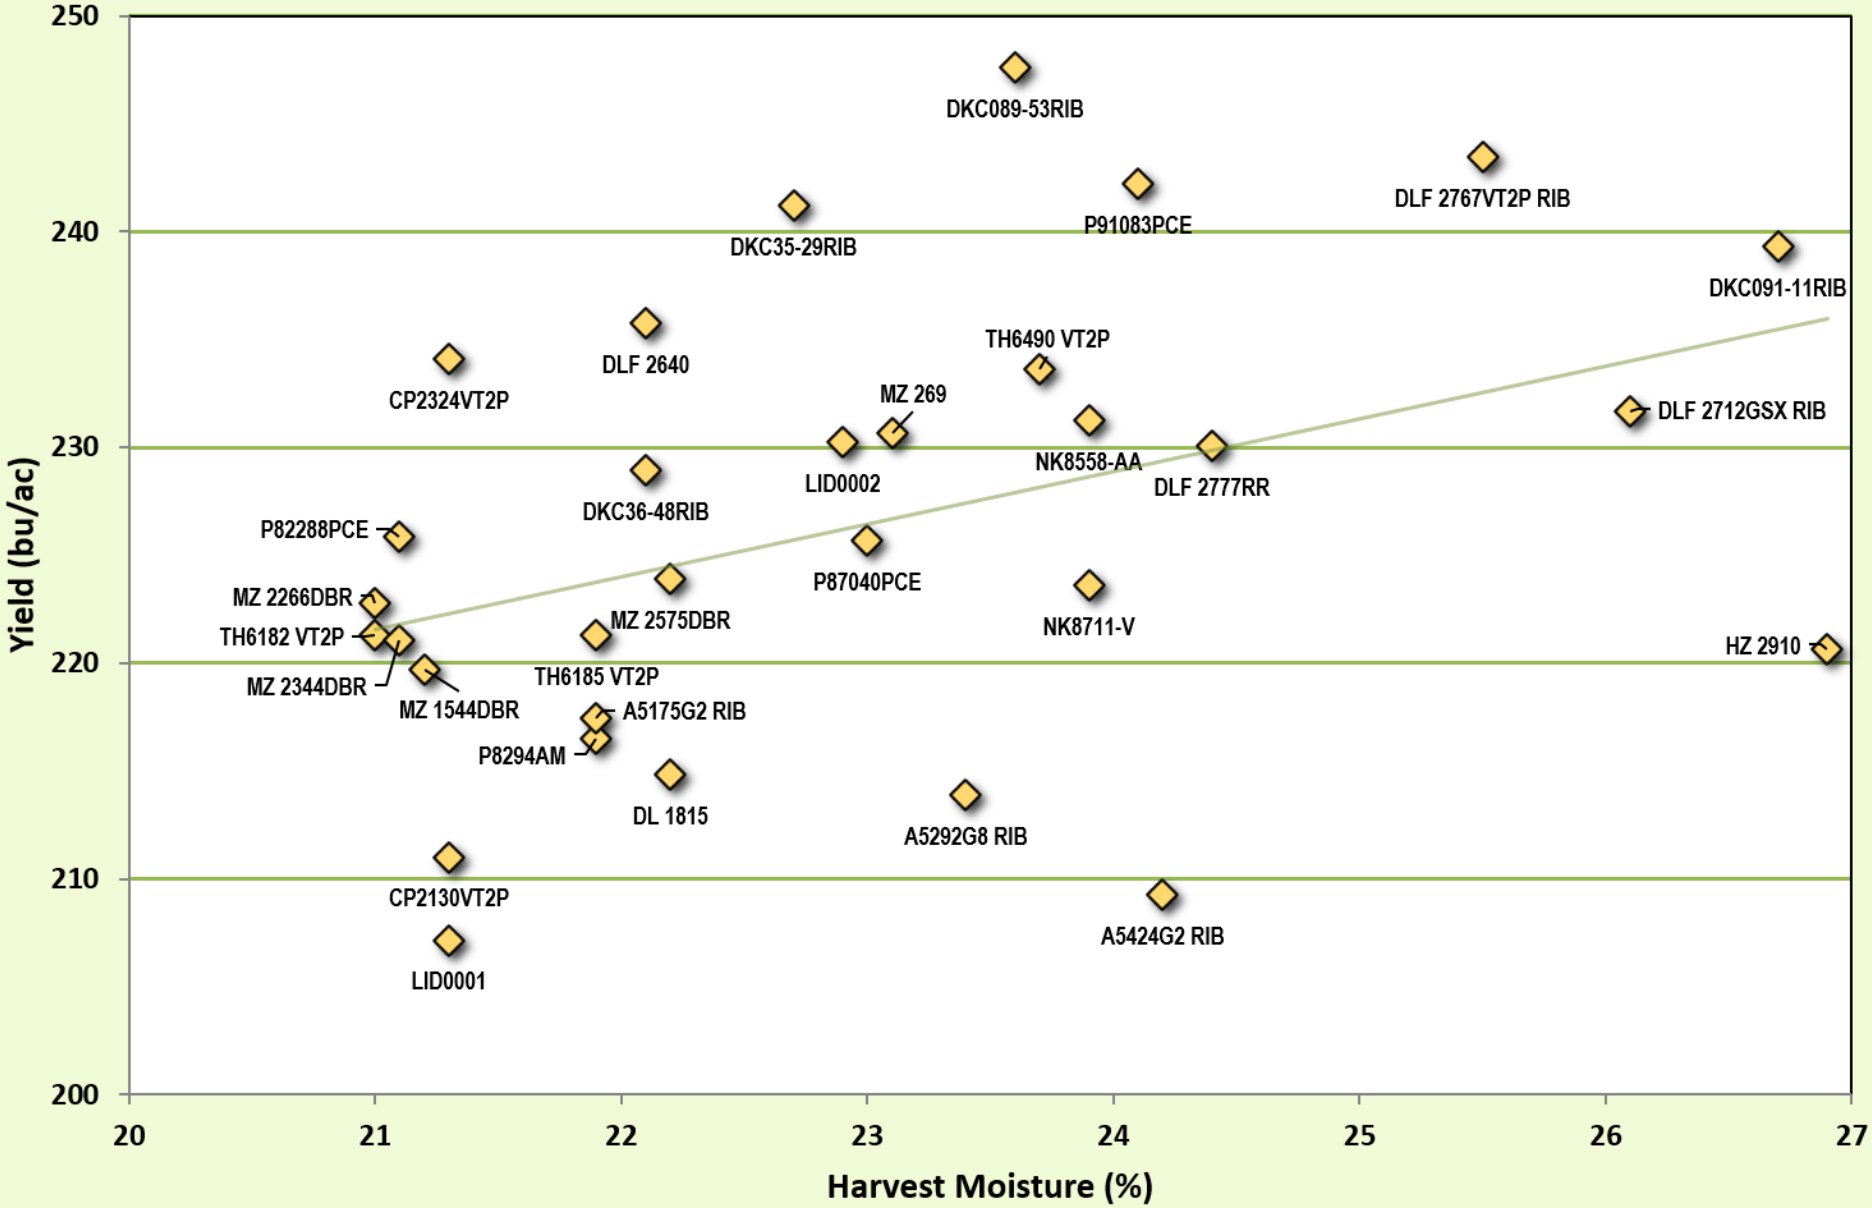

©2026 Ontario Corn Committee

Please refer to Table 1 for hybrid brand and complete agronomic performance data.

Average of 4 tests conducted in Harriston, Dundalk

Table 2: Elora, Kinburn, Port Hope, Wingham **2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee**

					2025-2026 averages[1]				2026 averages[2]				Results of 2026 Performance Trials											
					average of 7 trials				average of 4 trials				ELORA			KINBURN			PORT HOPE T2			WINGHAM		
CHU	Brand and/or Hybrid		GM Trait	Seed Trt	Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %
2350	LIDS	LID0001	0	A	**92**	**19.3**		**104**	**88**	**17.8**		**104**	104	20.2	1	94	17.8		82	16.3	0	75	16.8	0
2550	Thunder Seed	TH6185 VT2P	6	F	**93**	**20.4**		**102**	**93**	**19.2**		**102**	89	21.3	0	94	18.5		89	17.8	0	102	19.1	0
2550	Thunder Seed	TH8785 SS	8	F					**94**	**18.7**		**102**	99	20.1	0	92	17.6		92	17.3	0	95	19.9	0
2575	Maizex	MZ 2575DBR	6	F	**97**	**20.4**		**100**	**97**	**19.0**		**100**	100	19.6	1	95	18.4		94	17.4	0	103	20.6	0
2600	Maizex	MZ 269	0	F	**95**	**21.1**		**102**	**97**	**19.1**		**103**	101	19.5	0	96	19.9		95	17.2	0	98	19.8	0
2600	Maizex	MZ 2699DBR	6	F	**99**	**20.7**		**102**	**97**	**19.3**		**102**	100	20.4	0	97	18.7		97	17.5	0	98	20.7	0
2625	PRIDE Seeds	A5292G8 RIB	8	F					**91**	**19.3**		**103**	90	20.5	0	93	18.6		89	17.2	0	96	21.0	0
2625	PRIDE Seeds	A5424G2 RIB	6	F					**94**	**19.6**		**102**	102	21.2	1	95	19.6		94	17.8	0	85	19.9	0
2650	CROPLAN	2790VT2P/RIB	6	A	**99**	**20.7**		**101**	**99**	**19.6**		**101**	101	20.7	0	101	18.8		98	17.7	0	97	21.2	0
2650	CROPLAN	CP2667VT2P	6	A					**99**	**19.7**		**101**	106	19.8	0	97	20.3		92	17.6	0	105	21.0	0
2650	LIDS	LID0002	0	A	**99**	**20.6**		**106**	**95**	**18.7**		**107**	98	20.0	3	98	18.0		93	16.9	0	93	20.0	0
2650	Maizex	MZ 2784SMX	8	F					**94**	**19.2**		**102**	91	21.1	0	98	18.9		99	17.6	0	88	19.1	0
2650	PRIDE Seeds	A5580G4	32	P	**96**	**20.4**		**106**	**96**	**19.0**		**106**	92	21.6	0	94	18.0		96	16.6	0	105	19.8	0
2650	Saatbau	GARDISTO	0	C					**100**	**19.3**		**104**	97	20.4	1	105	19.2		104	17.5	0	95	20.1	0
2675	Horizon	HZ 2910	28	F	**100**	**22.2**		**98**	**103**	**21.2**		**98**	105	19.9	0	102	22.4		105	19.5	0	102	22.8	0
2675	Horizon	HZ 2945	0	F	**97**	**22.9**		**102**	**96**	**21.4**		**103**	93	21.6	3	98	20.9		92	19.0	0	102	23.9	0
2675	LIDS	LID0005	0	A					**102**	**19.2**		**103**	102	20.3	0	105	19.2		103	17.4	0	99	19.8	0
2675	Maizex	MZ 2803DBR	6	F					**109**	**19.4**		**102**	110	20.8	0	107	18.9		109	17.6	0	110	20.3	0
2675	NK Brand	NK8828-V	27	F					**97**	**19.6**		**101**	96	20.6	0	99	20.1		104	17.4	0	88	20.2	0
2700	CROPLAN	CP2925TRE	32	A	**98**	**21.4**		**102**	**98**	**19.6**		**103**	103	22.8	0	100	18.5		98	17.7	0	94	19.5	0
2700	De Dell	DL 3007	0	F	**93**	**21.1**		**105**	**92**	**20.0**		**105**	93	22.1	4	96	19.6		86	17.6	0	94	20.7	1
2700	Horizon	HZ 3010	33	F	**99**	**22.6**		**97**	**99**	**21.7**		**97**	102	21.4	0	95	22.1		102	20.1	0	99	23.0	0
2700	Maizex	MZ 3006DBR	6	F	**103**	**21.6**		**100**	**106**	**20.2**		**100**	105	21.9	0	106	19.2		109	17.9	0	102	21.7	0
2725	DLF	DLF 2712GSX RIB	8	AD	**102**	**22.1**		**100**	**102**	**20.0**		**100**	107	20.8	0	102	18.6		104	17.2	0	93	23.4	0
2725	DLF	DLF 2767VT2P RIB	6	AD	**105**	**21.3**		**100**	**103**	**19.6**		**101**	99	19.9	0	103	19.0		100	17.2	0	115	22.3	0
2725	NK Brand	NK9134-V	27	F					**98**	**20.1**		**101**	99	19.8	0	100	20.8		97	18.4	0	97	21.2	0
2725	PRIDE Seeds	A5959G2 RIB	6	F	**97**	**22.1**		**100**	**98**	**20.2**		**100**	105	20.6	1	98	20.0		96	18.1	0	93	22.0	0
2750	DEKALB	DKC091-11RIB	39	A	**105**	**21.9**		**100**	**104**	**19.9**		**100**	105	20.1	1	104	19.9		111	17.9	0	94	21.8	0
2750	Horizon	HZ 3260	0	F	**97**	**21.2**		**98**	**95**	**19.7**		**98**	102	19.6	3	98	20.0		96	18.2	0	86	20.8	0
2750	Maizex	MZ 314	0	F	**98**	**21.9**		**99**	**95**	**20.1**		**98**	97	20.4	0	95	19.8		99	18.2	0	90	22.2	0
2750	NK Brand	NK9175-DV	34	F	**97**	**23.0**		**100**	**95**	**20.9**		**101**	97	22.2	1	95	21.3		90	18.7	0	100	21.6	1
2750	Thunder Seed	TH6490 VT2P	6	F	**99**	**21.3**		**101**	**99**	**19.2**		**102**	96	19.8	1	103	18.9		100	17.1	0	101	20.8	0
2775	CROPLAN	CP3143VT2P	6	A	**101**	**22.8**		**99**	**99**	**21.0**		**99**	98	21.0	0	100	21.1		101	18.4	0	99	23.4	0
2775	CROPLAN	CP3225SSPRO	38	A					**95**	**19.8**		**101**	96	20.1	0	99	19.0		98	18.1	0	88	22.1	0
2775	DEKALB	DKC092-86RIB	38	P					**100**	**20.0**		**102**	103	19.6	1	101	19.8		98	18.0	0	101	22.6	0
2775	DLF	DLF 2726	0	AD					**107**	**18.8**		**102**	101	17.6	2	110	19.0		107	16.9	0	110	21.6	1
2775	DLF	DLF 2781VT2P RIB	6	AD					**98**	**19.5**		**101**	104	19.6	1	98	19.7		102	18.1	0	86	20.7	0
2775	Maizex	MZ 3220SSP	38	F					**104**	**20.3**		**99**	104	20.2	0	103	20.2		101	18.1	0	109	22.8	0
2775	NK Brand	NK9231-AA	28	F	**100**	**22.0**		**97**	**103**	**21.3**		**97**	102	20.4	0	98	21.8		102	19.8	0	109	23.3	0

Table 2: Elora, Kinburn, Port Hope, Wingham **2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee**

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 7 trials Yield Index	Moist %	Ldg %	Test Wt Index	2026 averages[2] average of 4 trials Yield Index	Moist %	Ldg %	Test Wt Index	Results of 2026 Performance Trials ELORA Yield Index	Moist %	Ldg %	KINBURN Yield Index	Moist %	Ldg %	PORT HOPE T2 Yield Index	Moist %	Ldg %	WINGHAM Yield Index	Moist %	Ldg %
2800	DEKALB	DKC42-90RIB	6	AD	**102**	**22.5**		**101**	**99**	**20.1**		**101**	101	20.6	1	101	20.0		98	17.8	0	100	22.1	0
2800	Horizon	HZ 3392	28	F					**101**	**22.6**		**98**	104	22.2	0	98	23.5		103	20.7	0	98	23.9	0
2800	Maizex	MZ 3432TRE	32	F	**104**	**22.7**		**96**	**104**	**21.1**		**96**	99	21.2	0	104	20.6		111	19.0	0	102	23.6	0
2800	NK Brand	NK9400-V	27	F	**104**	**22.3**		**101**	**101**	**20.9**		**100**	103	20.3	0	100	22.2		100	19.1	0	101	21.9	0
2800	Pioneer	P9466PCUE	42	L					**102**	**21.2**		**98**	108	22.5	0	101	21.1		104	18.7	0	96	22.6	0
2800	PRIDE Seeds	A6226G2	6	P	**102**	**22.1**		**99**	**100**	**20.2**		**100**	99	21.2	2	104	19.0		100	18.5	0	100	22.1	0
2825	De Dell	DL 3751	0	F	**101**	**23.5**		**100**	**99**	**21.8**		**100**	101	20.1	1	97	22.4		96	20.7	0	105	24.1	0
2825	Horizon	HZ 3480	34	F	**103**	**22.7**		**96**	**100**	**21.2**		**96**	108	21.1	0	91	22.0		100	18.4	0	102	23.5	0
2825	NK Brand	NK9501-DS	41	F									0	0.0	0	106	20.9					96	20.4	0
2825	Thunder Seed	TH6993 VT2P	6	F	**101**	**22.8**		**100**	**98**	**20.7**		**100**	107	21.4	0	100	20.6		96	18.0	0	93	22.8	0
2850	De Dell	DL 3905	0	F	**101**	**22.6**		**99**	**101**	**20.5**		**100**	100	20.0	0	101	20.1		93	17.9	1	115	23.8	0
2850	DEKALB	DKC094-94RIB	39	AD	**105**	**22.9**		**95**	**105**	**21.1**		**95**	102	21.5	0	108	20.7		107	19.1	0	103	23.2	0
2850	DLF	DLF 2847VT2P RIB	6	AD					**108**	**21.6**		**97**	110	21.4	0	100	21.6		109	19.7	0	115	23.8	0
2850	Horizon	HZ 3584	34	F	**98**	**22.1**		**97**	**99**	**20.7**		**96**	102	19.4	1	97	21.5		101	20.2	0	98	21.8	0
2850	Maizex	MZ 3505DBR	6	F	**98**	**22.7**		**99**	**100**	**21.2**		**99**	101	20.4	1	97	21.4		101	18.7	0	103	24.2	0
2875	DEKALB	DKC094-17RIB	6	A	**107**	**22.9**		**97**	**105**	**21.3**		**97**	101	21.1	0	103	21.1		104	18.3	0	113	24.6	0
2875	DLF	DLF 2891GSX RIB	8	AD	**105**	**23.3**		**98**	**103**	**21.8**		**98**	107	21.7	0	99	21.9		103	19.5	0	106	24.3	0
2900	DEKALB	DKC095-67RIB	38	P					**111**	**22.5**		**96**	115	22.9	0	108	22.5		112	20.8	0	110	23.7	0
2900	DEKALB	DKC46-40RIB	6	AD	**109**	**22.1**		**99**	**107**	**21.0**		**99**	103	21.4	0	101	20.8		108	18.6	0	116	23.2	0
2900	Pioneer	P96567V	40	L					**100**	**21.7**		**97**	102	21.6	0	102	20.6		102	19.5	0	93	25.0	0
2925	Pioneer	P98125V	40	L					**104**	**21.7**		**98**	100	19.8	0	105	21.3		105	18.3	0	107	27.3	0
2925	Pioneer	P9823Q	36	L					**100**	**21.5**		**98**	96	20.2	2	100	22.5		101	19.2	0	104	23.9	0
2925	Thunder Seed	TH6697 TRE	32	F					**103**	**22.0**		**99**	110	23.9	0	99	22.0		101	18.4	0	102	23.8	0
2950	Pioneer	P9845PCE	30	L					**107**	**23.0**		**96**	111	21.9	0	104	24.8		104	19.6	0	113	25.8	0
2950	Pioneer	P9955V	40	L					**102**	**21.7**		**101**	98	19.2	0	106	22.6		102	19.1	0	105	25.8	0
2975	Pioneer	P0035V	40	L					**103**	**23.3**		**97**	105	22.6	4	100	23.9		105	19.7	0	101	26.9	0
3000	Pioneer	P01851V	40	L					**107**	**24.7**		**95**	109	21.8	0	105	26.4		108	22.0	0	107	28.7	0
	LSD (0.10) for Yield Index Points*				**3**				**4**				9			5			6			9		
	Average all hybrids **				**234**	**21.9**		**68**	**237**	**20.5**		**69**	236	20.5	1	221	20.5		276	18.4	0	212	22.3	0

[1] Elora 2025-2026, Kinburn 2025-2026, Port Hope T2 2026, Wingham 2025-202 [2] Elora, Kinburn, Port Hope T2, Wingham


* The LSD is a measure of variability within the trial. Yield indices that differ by an amount less than or equal to the LSD should be considered to be equal.

** Average Yields are shown in bushels per acre. Average Test Weights are shown in kg/hl.

Hybrid selection should be based on the most data available. Emphasis should be put on averages from several locations and years because these provide a more accurate prediction of future performance than do single location results.

Note: The accuracy of moisture measurement decreases as moisture content increases. This also affects the accuracy of yield determination. Results for hybrids with moisture contents over 30% should be interpreted with much caution.

OCC 1 Year Averages (2026) for Area 2: Elora, Kinburn, Port Hope, Wingham.

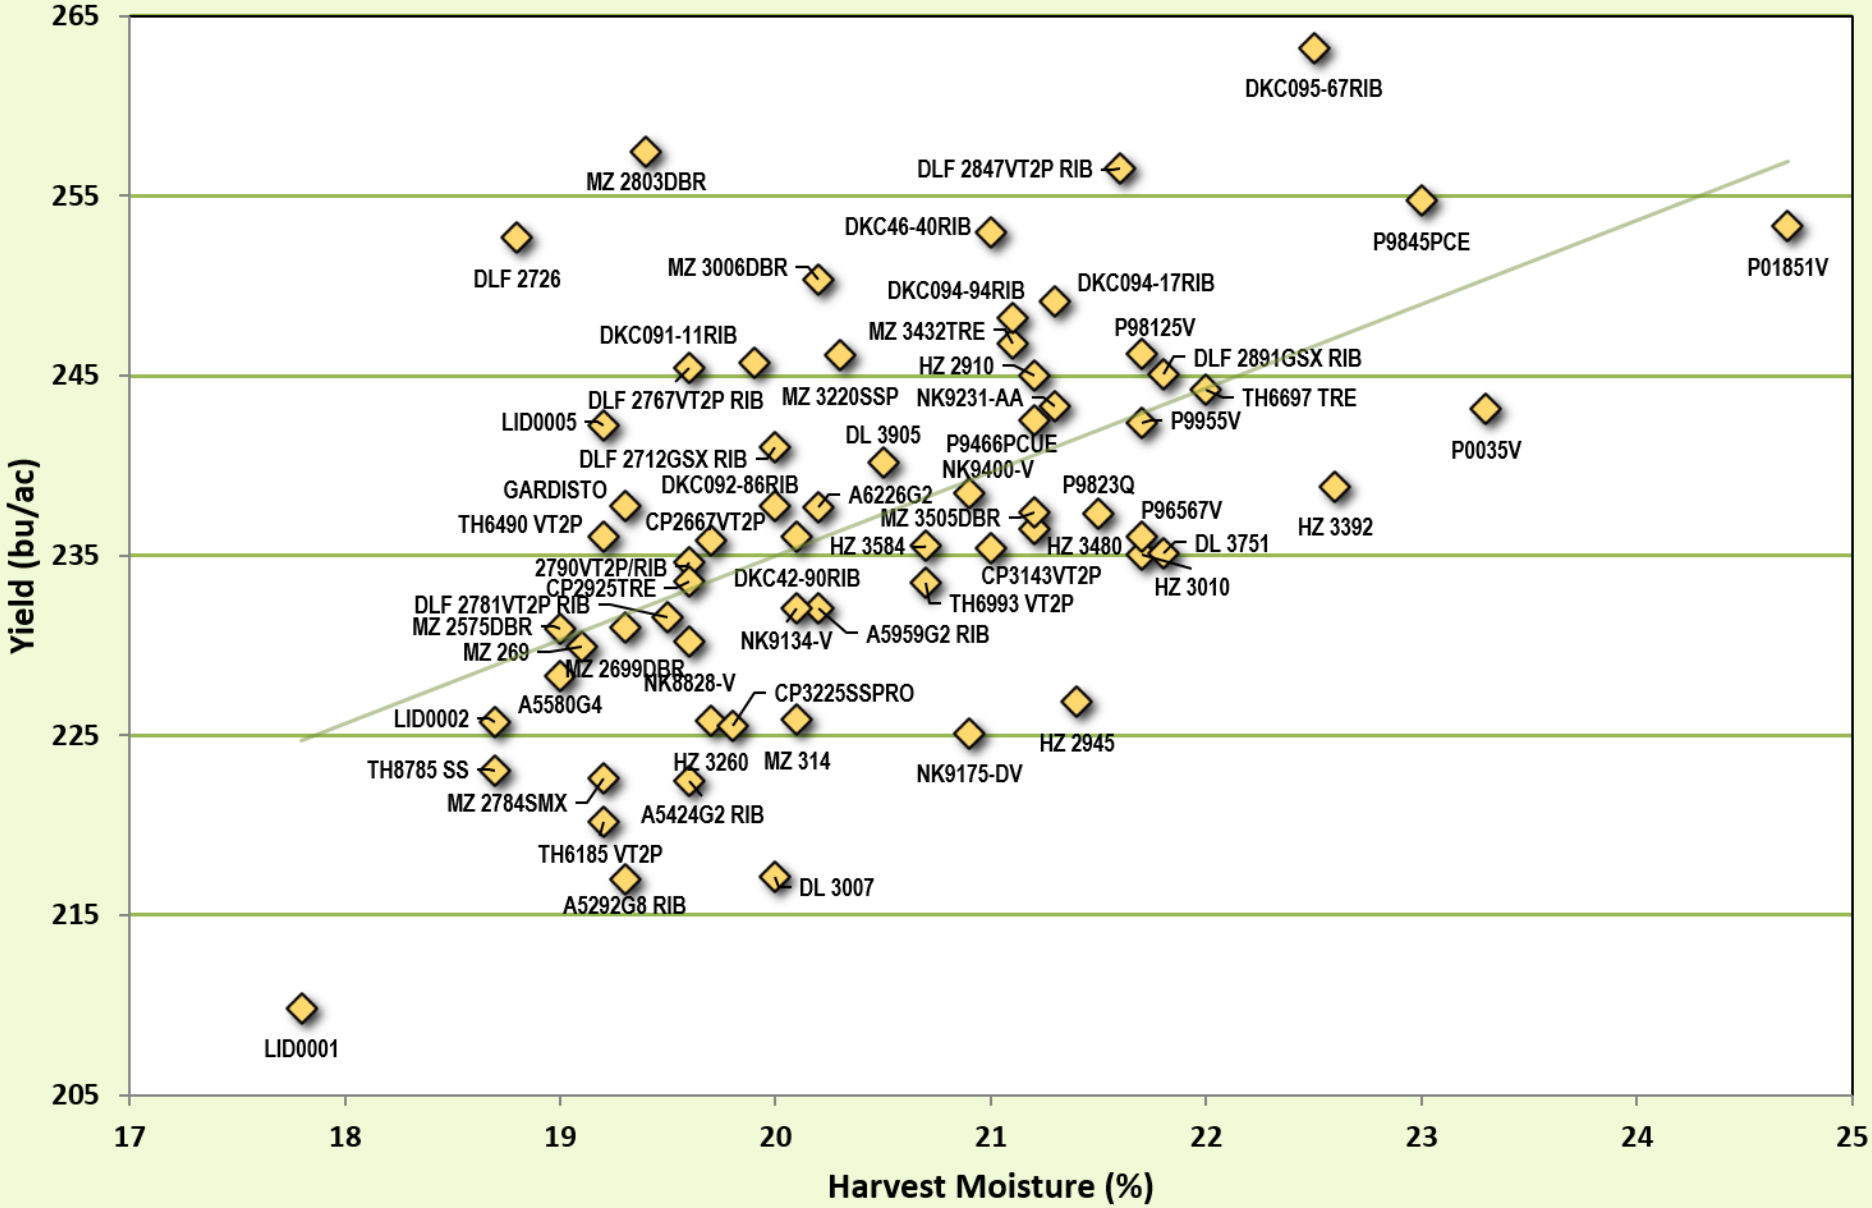


©2026 Ontario Corn Committee

Please refer to Table 2 for hybrid brand and complete agronomic performance data.

Average of 4 tests conducted in Elora, Kinburn, Port Hope, Wingham

OCC 2 Year Averages (2025-2026) for Area 2: Elora, Kinburn, Port Hope, Wingham.

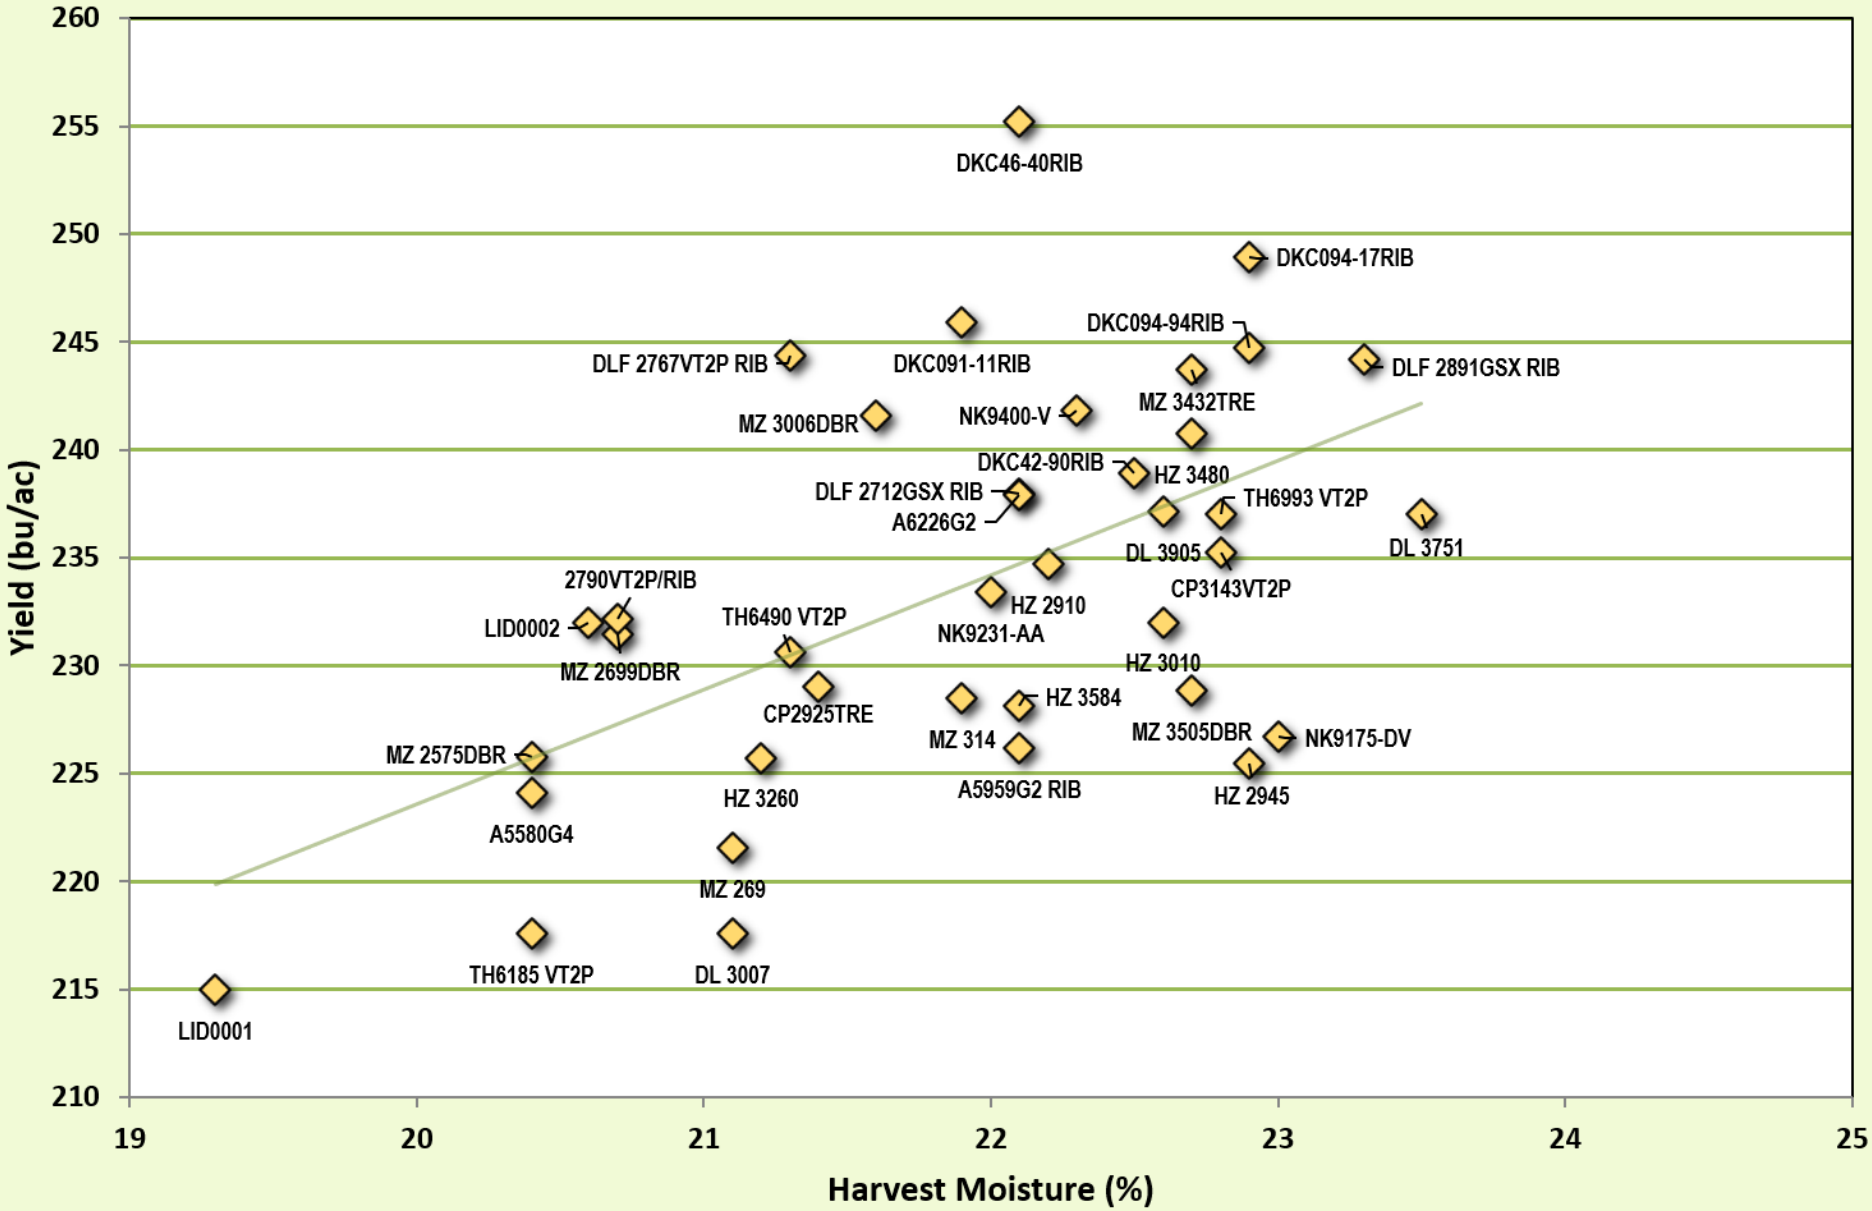

©2026 Ontario Corn Committee

Please refer to Table 2 for hybrid brand and complete agronomic performance data.

Average of 7 tests conducted in Elora, Kinburn, Port Hope, Wingham

Table 3E: Bainsville, Richmond (Ottawa 2025), Winchester **2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee**

					2025-2026 averages[1]				2026 averages[2]				Results of 2026 Performance Trials								
					average of 6 trials				average of 3 trials				BAINSVILLE			RICHMOND			WINCHESTER		
CHU	Brand and/or Hybrid		GM Trait	Seed Trt	Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %
2700	CROPLAN	CP2925TRE	32	A	**95**	**19.5**		**103**	**97**	**18.5**		**103**	93	18.6	0	101	17.9		98	19.0	
2700	Maizex	MZ 3006DBR	6	F	**99**	**19.3**		**102**	**101**	**18.8**		**101**	95	17.4	0	103	19.5		105	19.6	
2725	NK Brand	NK9134-V	27	F					**97**	**19.7**		**104**	99	19.1	0	96	19.8		98	20.1	
2725	PRIDE Seeds	A5959G2 RIB	6	F					**99**	**18.8**		**102**	98	19.0	0	100	18.5		98	19.0	
2750	Maizex	MZ 314	0	F	**100**	**20.2**		**101**	**100**	**19.3**		**102**	99	18.7	0	95	19.6		107	19.5	
2750	NK Brand	NK9175-DV	34	F	**97**	**21.1**		**103**	**96**	**19.6**		**105**	98	19.0	0	96	19.8		96	20.0	
2750	Saatbau	BAYREUT	0	C					**102**	**20.7**		**95**	104	19.2	1	105	21.5		97	21.4	
2750	Saatbau	COMBRESO	0	C					**98**	**21.8**		**97**	100	20.0	0	96	23.2		96	22.0	
2750	Thunder Seed	TH6490 VT2P	6	F	**99**	**19.0**		**103**	**99**	**18.6**		**104**	94	17.8	0	99	19.0		103	19.0	
2775	CROPLAN	CP3143VT2P	6	A	**100**	**20.2**		**101**	**99**	**19.4**		**101**	97	18.5	0	100	20.0		99	19.6	
2775	CROPLAN	CP3225SSPRO	38	A					**99**	**18.8**		**104**	95	18.4	0	100	19.3		102	18.8	
2775	Maizex	MZ 3220SSP	38	F					**102**	**19.7**		**101**	99	19.2	0	101	19.6		106	20.4	
2775	NK Brand	NK9231-AA	28	F	**98**	**21.4**		**99**	**99**	**20.2**		**100**	102	19.0	0	94	20.6		101	21.0	
2800	CROPLAN	CP3330VT2P	6	A	**101**	**21.9**		**100**	**99**	**21.6**		**99**	96	20.6	0	103	22.4		99	21.8	
2800	CROPLAN	CP3540VT4	39	A	**101**	**19.9**		**103**	**102**	**19.6**		**103**	102	18.8	0	101	20.5		102	19.6	
2800	Horizon	HZ 3392	28	F					**95**	**21.3**		**102**	91	17.8	0	97	23.4		97	22.6	
2800	Maizex	MZ 3432TRE	32	F	**100**	**20.7**		**99**	**102**	**19.3**		**99**	104	18.5	0	102	18.8		99	20.7	
2800	NK Brand	NK9400-V	27	F	**97**	**20.6**		**103**	**98**	**20.6**		**104**	96	19.5	0	99	21.5		99	20.9	
2800	PRIDE Seeds	A6226G2	6	P	**101**	**19.8**		**103**	**98**	**19.2**		**102**	95	18.5	0	100	19.2		100	19.9	
2800	Saatbau	FALCINO	0	C	**100**	**21.5**		**102**	**99**	**20.8**		**104**	97	20.2	0	100	21.7		99	20.4	
2825	De Dell	DL 3751	0	F	**98**	**22.0**		**103**	**99**	**21.2**		**103**	96	20.9	0	98	21.3		102	21.3	
2825	Horizon	HZ 3480	34	F	**99**	**20.6**		**100**	**100**	**20.0**		**99**	102	19.4	0	94	19.9		103	20.8	
2825	NK Brand	NK9501-DS	41	F												102	18.9		100	20.4	
2825	Thunder Seed	TH6993 VT2P	6	F	**100**	**20.2**		**102**	**98**	**19.3**		**103**	95	18.5	0	98	19.8		102	19.7	
2850	CROPLAN	CP3490VT2P	6	A	**102**	**21.0**		**100**	**98**	**20.4**		**100**	95	20.1	0	101	20.5		99	20.7	
2850	De Dell	DL 3905	0	F	**102**	**20.3**		**102**	**102**	**19.2**		**103**	105	18.1	0	98	19.5		103	20.0	
2850	DEKALB	DKC094-94RIB	39	AD	**107**	**21.3**		**98**	**106**	**19.7**		**99**	106	19.0	0	106	19.8		108	20.5	
2850	DLF	DLF 2847VT2P RIB	6	AD					**100**	**20.6**		**100**	103	19.8	0	101	20.0		97	21.9	
2850	Horizon	HZ 3584	34	F	**91**	**21.9**		**99**	**95**	**21.2**		**98**	93	20.6	0	95	21.9		95	21.1	
2850	Maizex	MZ 3505DBR	6	F	**97**	**20.3**		**101**	**97**	**19.3**		**101**	94	18.0	0	101	19.9		98	20.1	
2850	PRIDE Seeds	A6499G9 RIB	38	F					**99**	**19.8**		**100**	98	18.7	0	99	20.7		100	20.0	
2850	PRIDE Seeds	A6566G8 RIB	8	F	**98**	**19.7**		**103**	**97**	**18.8**		**105**	93	18.6	0	103	18.8		97	18.8	
2875	DEKALB	DKC094-17RIB	6	A	**105**	**21.1**		**100**	**106**	**20.2**		**100**	108	19.1	0	105	20.9		106	20.6	
2875	DLF	DLF 2891GSX RIB	8	AD	**98**	**21.7**		**100**	**98**	**20.9**		**100**	95	18.9	0	98	22.6		102	21.1	
2875	Horizon	HZ 3690	30	F	**103**	**21.7**		**99**	**101**	**20.5**		**100**	106	19.5	0	99	21.3		98	20.7	
2875	PRIDE Seeds	A6580G4 RIB	32	F	**97**	**21.1**		**102**	**98**	**20.8**		**101**	100	20.1	0	98	21.3		97	20.9	
2875	PRIDE Seeds	A6677G4 RIB	32	F					**101**	**20.6**		**98**	99	19.1	0	100	21.0		105	21.8	
2900	DEKALB	DKC095-67RIB	38	P					**105**	**21.3**		**98**	107	20.2	0	106	22.3		102	21.4	
2900	DEKALB	DKC096-21RIB	32	AD	**106**	**21.0**		**100**	**104**	**20.2**		**100**	107	19.6	0	101	20.4		102	20.6	
2900	Maizex	MZ 3704VT4	6	F	**101**	**21.7**		**100**	**102**	**20.8**		**100**	102	19.5	0	97	22.1		107	20.8	

Table 3E: Bainsville, Richmond (Ottawa 2025), Winchester

2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 6 trials Yield Index	Moist %	Ldg %	Test Wt Index	2026 averages[2] average of 3 trials Yield Index	Moist %	Ldg %	Test Wt Index	Results of 2026 Performance Trials BAINSVILLE Yield Index	Moist %	Ldg %	RICHMOND Yield Index	Moist %	Ldg %	WINCHESTER Yield Index	Moist %	Ldg %
2900	Maizex	MZ 3751TRE	32	F					**101**	**20.8**		**97**	102	19.7	0	102	21.2		100	21.4	
2900	Pioneer	P96567V	40	L					**104**	**20.2**		**102**	105	19.4	0	99	20.9		108	20.2	
2925	CROPLAN	CP3790VT2P	6	A	**102**	**22.6**		**98**	**101**	**21.6**		**98**	105	20.0	0	100	22.9		96	22.0	
2925	Maizex	MZ 3794TRE	38	F					**99**	**21.6**		**94**	101	20.6	0	99	21.9		97	22.4	
2925	NK Brand	NK9819-V	27	F					**100**	**22.0**		**99**	103	20.9	0	98	23.0		99	22.1	
2925	Pioneer	P98125V	40	L					**105**	**21.5**		**101**	109	19.8	0	104	23.8		102	20.9	
2925	Pioneer	P9823Q	36	L	**103**	**21.8**		**99**	**99**	**21.2**		**99**	100	19.9	0	101	21.7		97	22.1	
2925	Thunder Seed	TH6697 TRE	32	F	**98**	**21.3**		**101**	**100**	**20.9**		**101**	93	20.3	0	102	21.4		105	20.9	
2950	CROPLAN	CP3980VT2P	6	A	**101**	**21.5**		**99**	**100**	**20.9**		**99**	99	20.4	0	102	21.1		99	21.2	
2950	DEKALB	DKC098-91RIB	39	P					**103**	**20.7**		**98**	106	18.9	0	98	22.0		105	21.1	
2950	DLF	DLF 2926VT4P RIB	38	AD	**100**	**22.4**		**97**	**101**	**21.2**		**98**	100	19.3	0	103	21.9		99	22.2	
2950	LIDS	LID0006	0	A					**100**	**20.6**		**98**	102	19.3	0	101	21.8		98	20.7	
2950	Maizex	MZ 397	0	F	**98**	**21.8**		**99**	**98**	**20.8**		**99**	97	19.4	0	102	21.3		94	21.6	
2950	Maizex	MZ 4026SSP	38	F	**101**	**22.2**		**100**	**102**	**21.6**		**100**	102	20.1	0	100	23.0		102	21.7	
2950	NK Brand	NK9805-DV	34	F	**97**	**21.9**		**100**	**98**	**21.2**		**100**	101	19.8	0	97	22.8		96	21.0	
2950	Pioneer	P9845PCE	30	L	**101**	**23.0**		**97**	**103**	**22.2**		**98**	108	21.0	0	99	23.3		101	22.3	
2950	Pioneer	P9955V	40	L					**102**	**21.3**		**103**	104	20.0	0	103	22.0		99	21.8	
2975	DLF	DLF 2991VT2P RIB	6	AD	**99**	**21.7**		**98**	**99**	**20.6**		**99**	97	19.6	0	99	20.5		101	21.5	
2975	Maizex	MZ 4049SMX	8	F	**97**	**22.5**		**99**	**97**	**21.9**		**99**	94	20.7	0	100	22.9		96	22.2	
2975	NK Brand	NK9908-AA	28	F	**101**	**21.9**		**100**	**101**	**21.2**		**101**	102	19.3	0	101	21.5		101	22.6	
2975	Pioneer	P0035V	40	L					**98**	**21.9**		**101**	103	19.9	0	95	24.0		96	21.9	
3000	DLF	DLF 3039TRE RIB	32	AD	**102**	**23.4**		**98**	**100**	**22.7**		**97**	98	21.4	0	104	24.0		98	22.8	
3000	Pioneer	P01851V	40	L					**101**	**24.7**		**97**	103	22.5	0	102	27.9		97	23.6	
3025	DEKALB	DKC100-01RIB	39	A	**107**	**21.1**		**98**	**107**	**20.2**		**97**	111	19.5	0	103	20.6		106	20.5	
3050	DEKALB	DKC099-59RIB	38	A	**102**	**23.4**		**96**	**100**	**22.8**		**96**	101	21.1	0	102	23.3		98	24.0	
3075	DEKALB	DKC101-33RIB	38	A	**101**	**24.6**		**93**	**100**	**23.2**		**94**	98	21.4	0	105	24.7		97	23.6	
3100	Pioneer	P03115V	40	L					**94**	**26.6**		**94**	98	24.5	0	91	30.0		92	25.2	
	LSD (0.10) for Yield Index Points*				**4**				**3**				5			5			7		
	Average all hybrids **				**206**	**21.3**		**68**	**242**	**20.7**		**68**	270	19.6	0	221	21.4		236	21.1	

[1] Bainsville 2025-2026, Ottawa 2025, Winchester 2025-2026, Richmond 2026 [2] Bainsville, Winchester, Richmond


* The LSD is a measure of variability within the trial. Yield indices that differ by an amount less than or equal to the LSD should be considered to be equal.

** Average Yields are shown in bushels per acre. Average Test Weights are shown in kg/hl.

Hybrid selection should be based on the most data available. Emphasis should be put on averages from several locations and years because these provide a more accurate prediction of future performance than do single location results.

Note: The accuracy of moisture measurement decreases as moisture content increases. This also affects the accuracy of yield determination. Results for hybrids with moisture contents over 30% should be interpreted with much caution.

OCC 1 Year Averages (2026) for Area 3E: Bainsville, Ottawa, Winchester.

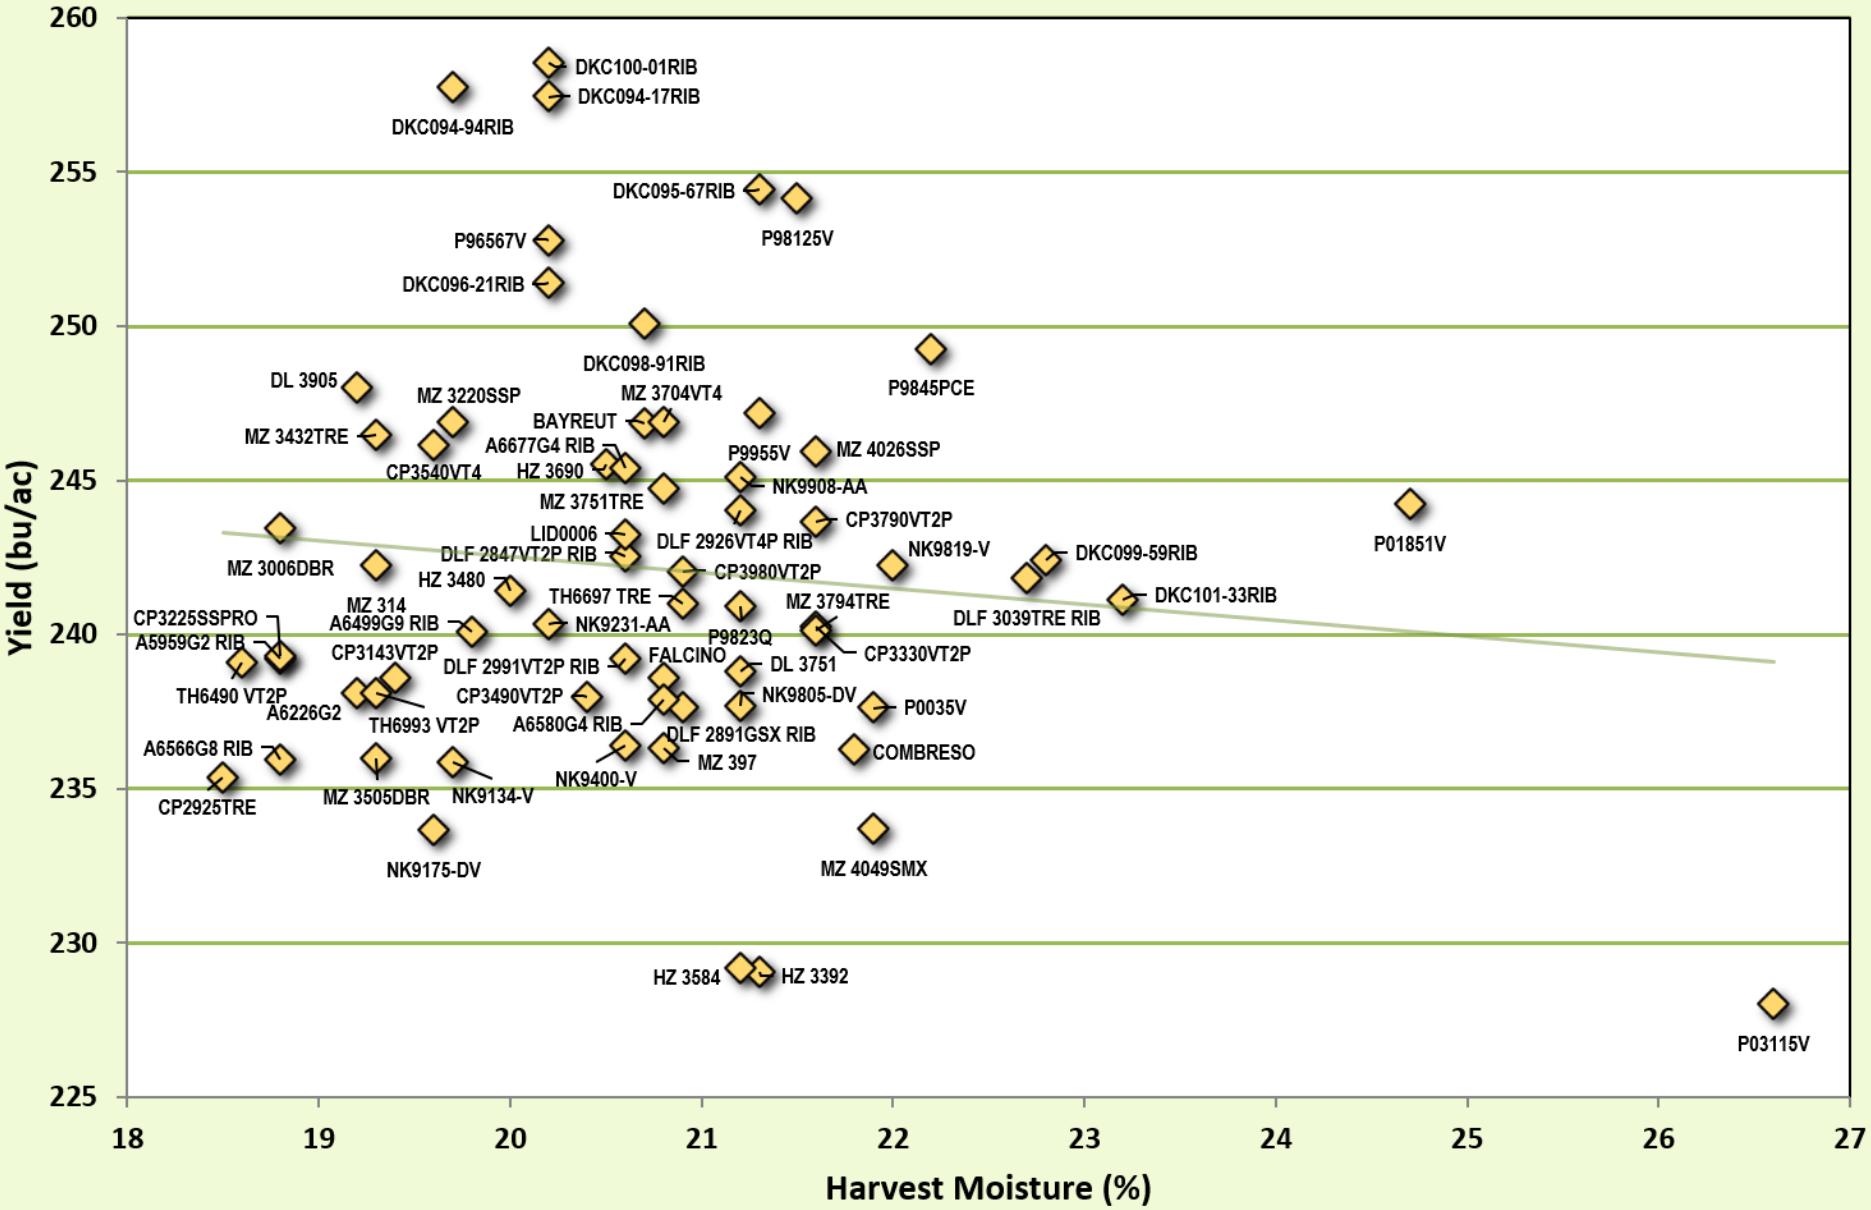


©2026 Ontario Corn Committee

Please refer to Table 3E for hybrid brand and complete agronomic performance data.

Average of 3 tests conducted in Bainsville, Ottawa, Winchester

OCC 2 Year Averages (2025-2026) for Area 3E: Bainsville, Ottawa, Winchester.

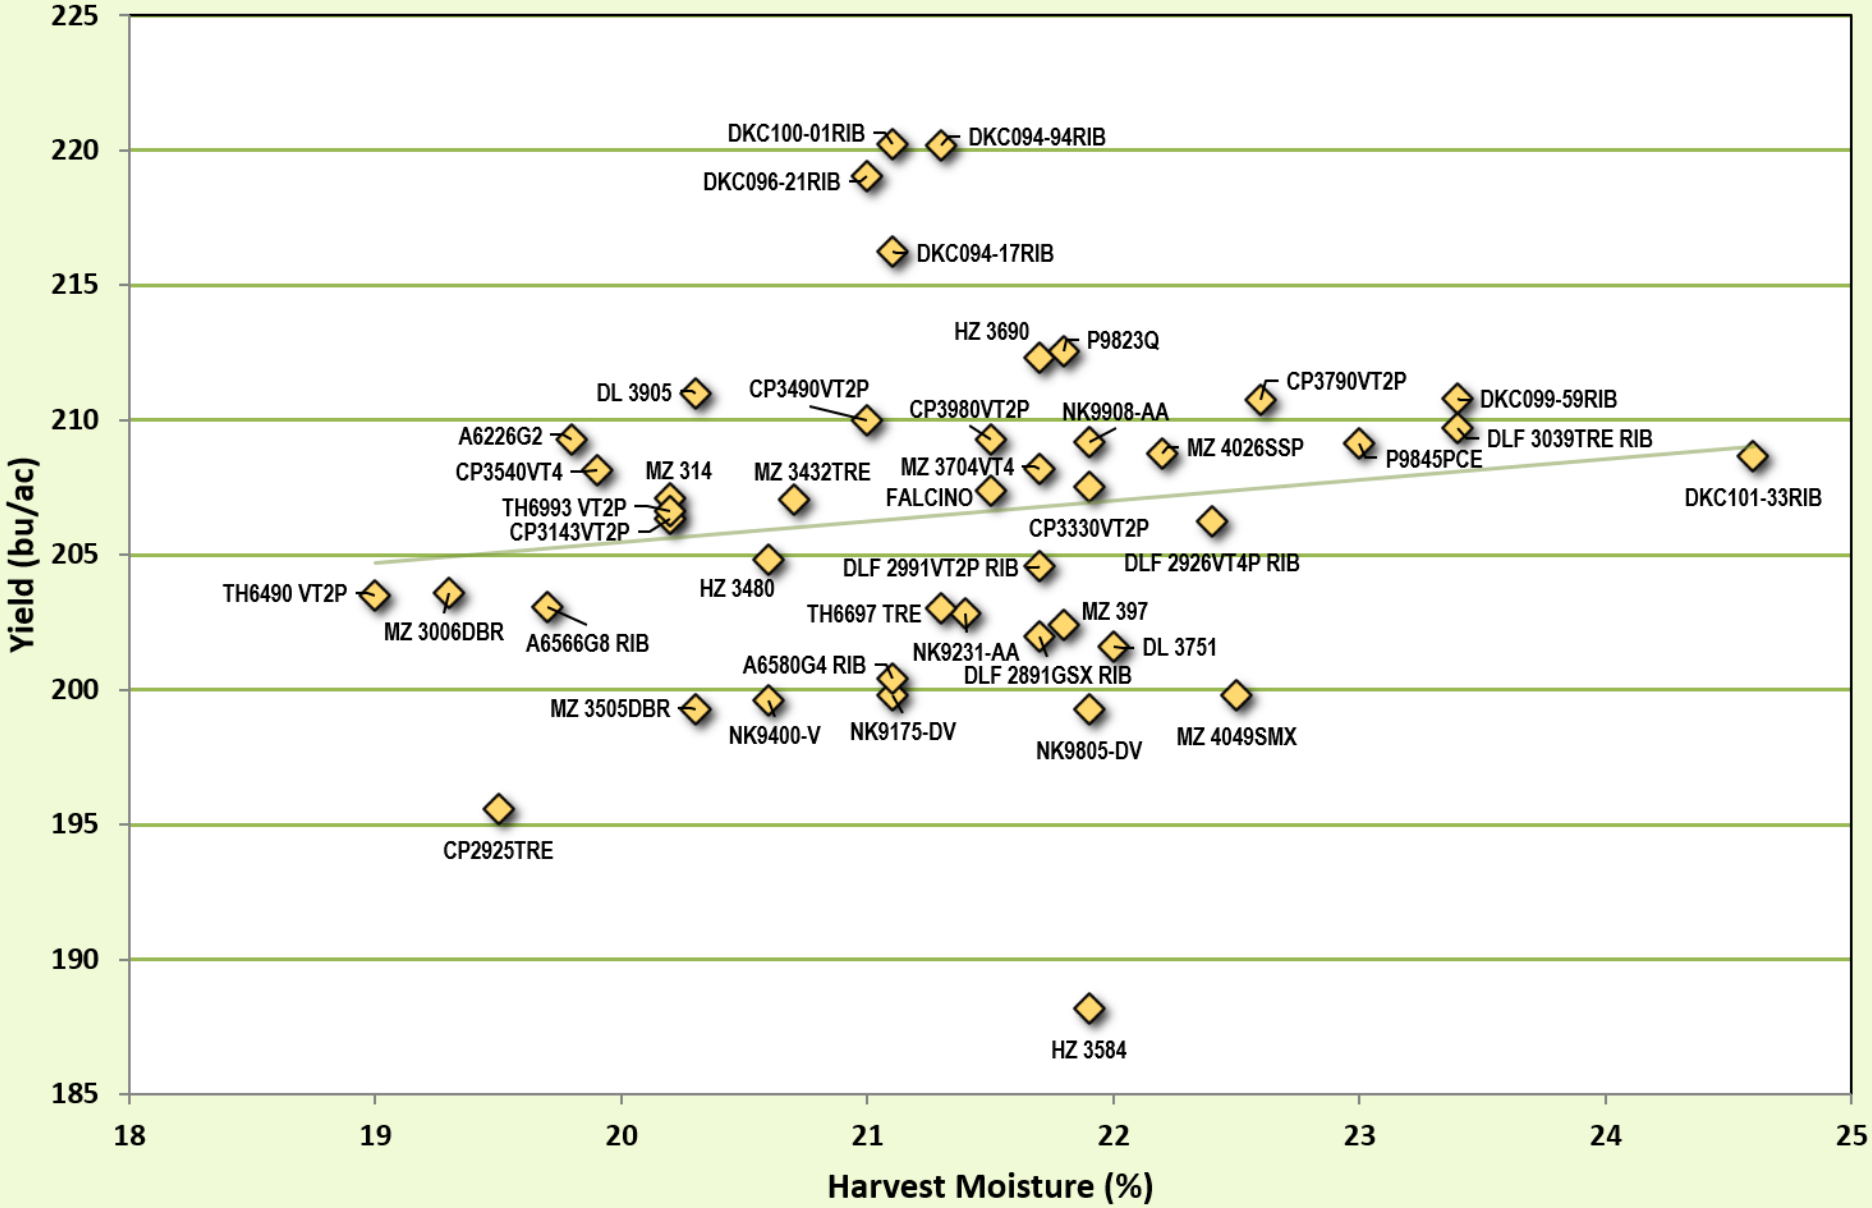

©2026 Ontario Corn Committee

Please refer to Table 3E for hybrid brand and complete agronomic performance data.

Average of 6 tests conducted in Bainsville, Ottawa, Winchester

Table 3W: Blyth, Port Hope, Woodstock 3W-Waterloo 2025

2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 5 trials				2026 averages[2] average of 3 trials				Results of 2026 Performance Trials								
													BLYTH			PORT HOPE			WOODSTOCK 3W		
					Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %
2700	CROPLAN	CP2925TRE	32	A	**93**	**21.0**	**0**	**103**	**92**	**19.4**	**0**	**104**	93	22.5	0	97	17.6	0	86	18.2	0
2700	Maizex	MZ 3006DBR	6	F	**102**	**21.2**	**0**	**101**	**104**	**20.2**	**0**	**102**	104	23.4	0	101	18.0	0	107	19.3	0
2725	NK Brand	NK9134-V	27	F					**93**	**20.3**	**0**	**102**	91	23.3	0	93	18.6	0	96	18.9	0
2725	PRIDE Seeds	A5959G2 RIB	6	F					**92**	**20.0**	**0**	**103**	90	23.6	0	99	18.0	0	88	18.5	0
2750	Maizex	MZ 314	0	F					**91**	**20.1**	**0**	**102**	90	23.7	0	99	18.0	0	85	18.6	0
2750	Thunder Seed	TH6490 VT2P	6	F	**98**	**20.7**	**0**	**103**	**97**	**19.4**	**0**	**103**	92	22.5	0	100	17.6	0	100	18.2	0
2775	CROPLAN	CP3143VT2P	6	A	**98**	**21.7**	**0**	**100**	**97**	**20.5**	**0**	**101**	100	24.3	0	97	18.5	0	93	18.7	0
2775	CROPLAN	CP3225SSPRO	38	A					**90**	**20.4**	**0**	**103**	93	24.3	0	93	18.1	0	84	18.7	0
2775	Maizex	MZ 3220SSP	38	F					**100**	**20.6**	**0**	**101**	102	25.0	0	100	18.1	0	98	18.8	0
2775	NK Brand	NK9231-AA	28	F	**96**	**22.0**	**0**	**100**	**97**	**21.5**	**0**	**100**	99	25.4	0	99	19.2	0	92	19.9	1
2800	CROPLAN	CP3330VT2P	6	A	**101**	**23.5**	**0**	**101**	**102**	**22.3**	**0**	**100**	102	27.9	0	100	19.0	0	105	20.0	0
2800	CROPLAN	CP3540VT4	39	A	**104**	**22.0**	**0**	**102**	**104**	**20.5**	**0**	**102**	98	25.0	0	105	18.1	0	107	18.5	0
2800	Horizon	HZ 3392	28	F					**98**	**22.4**	**1**	**100**	94	26.8	0	96	20.8	2	102	19.5	0
2800	Maizex	MZ 3432TRE	32	F	**101**	**22.9**	**0**	**99**	**102**	**21.7**	**0**	**98**	102	26.0	0	107	19.2	0	98	19.8	0
2800	NK Brand	NK9400-V	27	F	**103**	**21.8**	**0**	**103**	**102**	**20.7**	**0**	**104**	97	24.7	0	103	18.6	0	105	18.8	0
2800	PRIDE Seeds	A6226G2	6	P	**94**	**21.8**	**0**	**102**	**93**	**20.6**	**0**	**101**	90	24.6	0	95	18.3	0	93	19.0	0
2825	De Dell	DL 3751	0	F					**96**	**21.6**	**0**	**102**	105	24.5	0	90	20.0	0	94	20.2	0
2825	Horizon	HZ 3480	34	F	**96**	**22.1**	**0**	**99**	**94**	**20.9**	**0**	**100**	91	23.9	1	94	18.3	0	96	20.3	0
2825	NK Brand	NK9501-DS	41	F									91	22.1	2						
2825	Thunder Seed	TH6993 VT2P	6	F	**92**	**22.2**	**0**	**102**	**92**	**20.8**	**0**	**102**	94	24.8	0	94	18.0	0	87	19.6	0
2850	CROPLAN	CP3490VT2P	6	A	**100**	**22.8**	**0**	**100**	**98**	**21.6**	**0**	**101**	98	26.0	0	97	19.4	0	100	19.2	0
2850	De Dell	DL 3905	0	F	**101**	**22.2**	**1**	**100**	**104**	**20.7**	**2**	**101**	102	24.5	3	101	18.4	0	107	19.2	3
2850	DEKALB	DKC094-94RIB	39	AD	**102**	**23.0**	**0**	**97**	**102**	**21.4**	**0**	**97**	101	26.1	0	97	18.5	0	108	19.6	0
2850	DLF	DLF 2847VT2P RIB	6	AD					**105**	**21.8**	**0**	**100**	105	26.4	0	101	18.9	0	108	20.1	0
2850	Horizon	HZ 3584	34	F	**94**	**22.2**	**0**	**99**	**95**	**21.4**	**0**	**98**	99	24.9	0	93	19.8	0	93	19.6	0
2850	Maizex	MZ 3505DBR	6	F	**101**	**22.2**	**0**	**101**	**103**	**21.0**	**1**	**101**	107	24.7	0	99	18.4	0	103	19.9	2
2850	PRIDE Seeds	A6499G9 RIB	38	F					**102**	**21.0**	**0**	**99**	109	25.0	0	98	18.6	0	101	19.4	0
2850	PRIDE Seeds	A6566G8 RIB	8	F	**95**	**22.2**	**0**	**102**	**92**	**20.4**	**0**	**103**	95	23.9	1	94	17.7	0	86	19.6	0
2875	DEKALB	DKC094-17RIB	6	A	**103**	**22.7**	**0**	**99**	**103**	**21.5**	**0**	**100**	105	27.2	0	104	18.3	0	100	19.0	0
2875	DLF	DLF 2891GSX RIB	8	AD	**103**	**23.0**	**0**	**100**	**103**	**21.8**	**0**	**100**	100	26.3	0	100	19.6	0	108	19.5	1
2875	Horizon	HZ 3690	30	F	**103**	**22.7**	**0**	**100**	**101**	**21.3**	**0**	**99**	105	25.1	1	97	19.2	0	100	19.4	0
2875	PRIDE Seeds	A6580G4 RIB	32	F	**99**	**22.8**	**0**	**102**	**98**	**21.5**	**0**	**102**	101	25.8	0	97	18.8	1	95	19.8	0
2875	PRIDE Seeds	A6677G4 RIB	32	F					**103**	**21.0**	**0**	**98**	107	24.6	0	104	19.2	0	97	19.1	0
2900	DEKALB	DKC095-67RIB	38	P					**111**	**23.2**	**0**	**97**	110	27.7	0	107	20.3	1	115	21.6	0
2900	DEKALB	DKC46-40RIB	6	AD	**101**	**22.1**	**0**	**101**	**102**	**20.7**	**0**	**102**	107	24.8	0	106	18.7	0	93	18.5	0
2900	Maizex	MZ 3751TRE	32	F					**104**	**21.8**	**0**	**97**	105	26.0	0	101	19.1	0	107	20.4	0
2900	Pioneer	P96567V	40	L					**101**	**21.3**	**0**	**101**	96	26.5	0	102	18.4	0	105	18.9	0

Table 3W: Blyth, Port Hope, Woodstock 3W-Waterloo 2025 — 2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 5 trials Yield Index	Moist %	Ldg %	Test Wt Index	2026 averages[2] average of 3 trials Yield Index	Moist %	Ldg %	Test Wt Index	Results of 2026 Performance Trials BLYTH Yield Index	Moist %	Ldg %	PORT HOPE Yield Index	Moist %	Ldg %	WOODSTOCK 3W Yield Index	Moist %	Ldg %
2925	CROPLAN	CP3790VT2P	6	A	**101**	**24.1**	**0**	**98**	**100**	**23.2**	**0**	**98**	99	29.0	1	101	20.1	0	99	20.6	0
2925	Maizex	MZ 3794TRE	38	F					**102**	**21.5**	**0**	**96**	102	24.5	0	103	20.1	0	102	19.8	1
2925	NK Brand	NK9819-V	27	F					**105**	**22.8**	**0**	**99**	106	28.2	0	101	20.6	0	107	19.6	1
2925	Pioneer	P98125V	40	L					**102**	**23.4**	**1**	**99**	102	31.0	2	106	19.0	0	98	20.1	0
2925	Pioneer	P9823Q	36	L	**100**	**23.4**	**0**	**99**	**98**	**22.2**	**0**	**99**	102	26.9	0	97	19.6	0	95	20.2	0
2925	Thunder Seed	TH6697 TRE	32	F	**102**	**23.0**	**0**	**102**	**100**	**21.8**	**0**	**102**	99	27.0	0	97	18.5	0	106	20.0	0
2950	CROPLAN	CP3980VT2P	6	A	**102**	**21.9**	**0**	**100**	**103**	**21.1**	**0**	**100**	100	24.1	0	105	19.2	0	105	19.9	0
2950	DEKALB	DKC098-91RIB	39	P					**108**	**22.7**	**0**	**98**	103	28.8	0	105	19.0	0	116	20.4	0
2950	DLF	DLF 2926VT4P RIB	38	AD	**103**	**23.7**	**0**	**98**	**104**	**22.2**	**0**	**99**	103	27.9	0	106	19.4	0	104	19.4	0
2950	LIDS	LID0006	0	A					**108**	**21.6**	**0**	**100**	108	26.7	0	107	18.5	0	108	19.6	0
2950	Maizex	MZ 397	0	F					**95**	**21.7**	**0**	**99**	96	26.0	0	99	18.9	0	91	20.1	0
2950	Maizex	MZ 4026SSP	38	F	**98**	**23.4**	**0**	**100**	**98**	**21.7**	**0**	**100**	100	26.3	0	99	19.1	1	96	19.6	0
2950	NK Brand	NK9805-DV	34	F	**101**	**22.8**	**0**	**99**	**98**	**22.0**	**0**	**100**	101	26.2	0	97	19.7	0	96	19.9	0
2950	Pioneer	P9845PCE	30	L	**104**	**24.4**	**0**	**98**	**106**	**23.2**	**0**	**98**	105	29.5	0	99	20.3	0	113	19.9	0
2950	Pioneer	P9955V	40	L					**107**	**22.7**	**0**	**102**	103	27.4	0	105	20.2	0	112	20.5	0
2950	PRIDE Seeds	A6846G6	38	P	**102**	**23.8**	**0**	**98**	**105**	**22.6**	**0**	**98**	97	28.3	0	107	19.7	0	109	19.9	0
2975	DLF	DLF 2991VT2P RIB	6	AD	**98**	**22.7**	**0**	**99**	**96**	**21.4**	**0**	**99**	97	26.3	0	97	19.0	0	93	18.9	0
2975	Maizex	MZ 4049SMX	8	F	**98**	**24.0**	**0**	**100**	**97**	**22.6**	**0**	**99**	100	27.6	0	95	19.6	0	97	20.5	0
2975	NK Brand	NK9908-AA	28	F	**98**	**22.9**	**0**	**100**	**97**	**22.5**	**0**	**100**	98	27.1	0	99	20.5	0	94	20.0	0
2975	Pioneer	P0035V	40	L					**102**	**22.9**	**0**	**101**	105	29.2	0	99	19.1	0	103	20.5	0
2975	PRIDE Seeds	A6975G2	6	F	**100**	**23.7**	**0**	**100**	**100**	**22.4**	**0**	**100**	99	25.8	0	100	20.5	0	102	20.8	0
3000	DLF	DLF 3039TRE RIB	32	AD	**104**	**24.3**	**0**	**99**	**104**	**23.4**	**0**	**99**	96	28.7	0	106	20.9	0	109	20.5	0
3000	Pioneer	P01851V	40	L					**102**	**24.4**	**0**	**98**	103	30.3	0	105	21.4	0	98	21.4	0
3075	DEKALB	DKC101-33RIB	38	A	**106**	**25.8**	**0**	**96**	**105**	**24.2**	**0**	**95**	105	30.9	0	105	20.4	0	105	21.2	0
3100	Maizex	MZ 4158DBR	6	F	**102**	**24.5**	**0**	**98**	**104**	**23.3**	**0**	**98**	101	29.0	0	107	20.2	0	104	20.6	0
3100	Pioneer	P03115V	40	L					**96**	**25.4**	**0**	**98**	99	32.2	0	94	22.6	0	95	21.3	0
	LSD (0.10) for Yield Index Points*				**4**				**5**				8			7			12		
	Average all hybrids **				**267**	**22.8**	**0**	**68**	**270**	**21.7**	**0**	**71**	250	26.2	0	288	19.2	0	271	19.7	0

[1] Blyth 2025-2026, Port Hope 2026, Waterloo 2025, Woodstock 3W 2026 [2] Blyth, Port Hope, Woodstock 3W


* The LSD is a measure of variability within the trial. Yield indices that differ by an amount less than or equal to the LSD should be considered to be equal.

** Average Yields are shown in bushels per acre. Average Test Weights are shown in kg/hl.

Hybrid selection should be based on the most data available. Emphasis should be put on averages from several locations and years because these provide a more accurate prediction of future performance than do single location results.

Note: The accuracy of moisture measurement decreases as moisture content increases. This also affects the accuracy of yield determination. Results for hybrids with moisture contents over 30% should be interpreted with much caution.

OCC 1 Year Averages (2026) for Area 3W: Blyth, Port Hope, Waterloo.

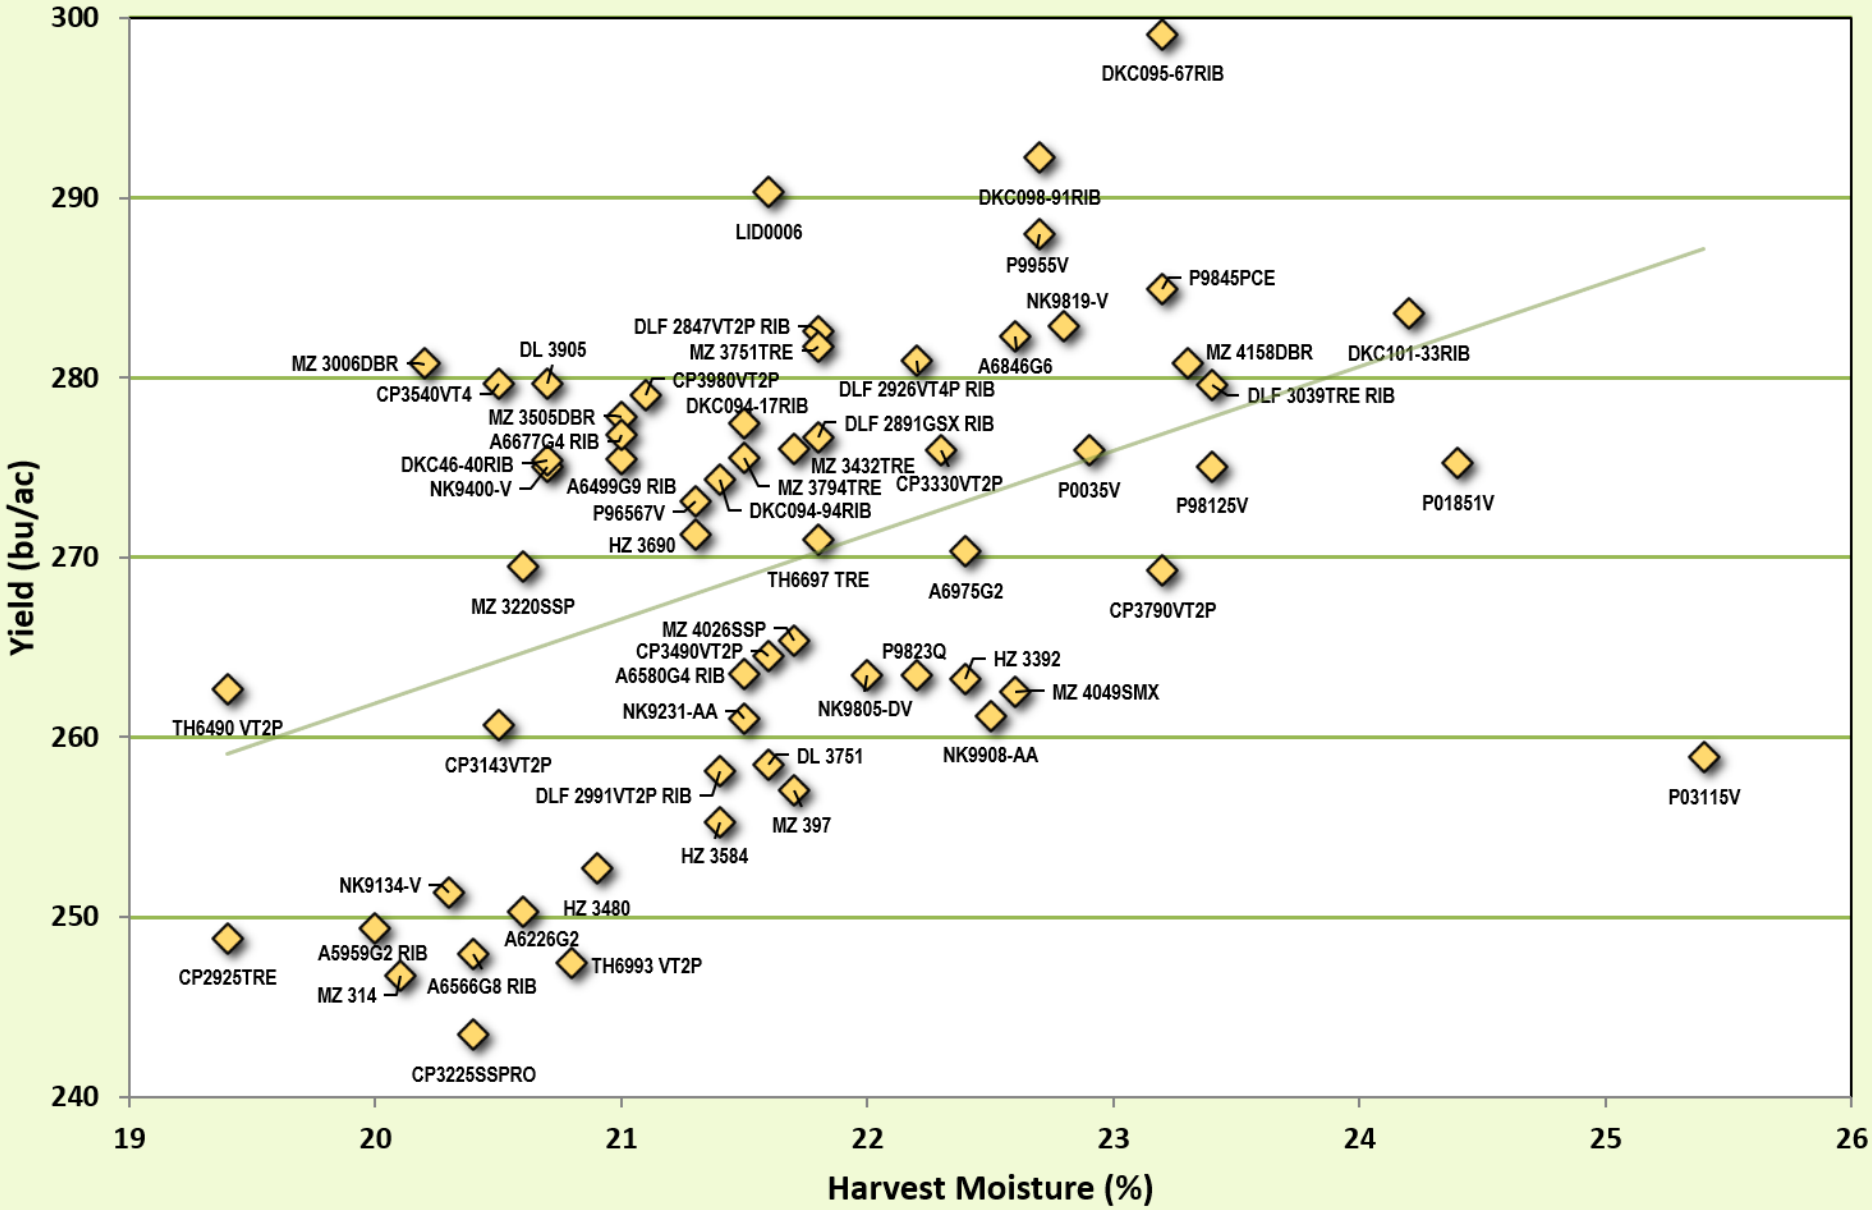


©2026 Ontario Corn Committee

Please refer to Table 3W for hybrid brand and complete agronomic performance data.

Average of 3 tests conducted in Blyth, Port Hope, Waterloo

OCC 2 Year Averages (2025-2026) for Area 3W: Blyth, Port Hope, Waterloo.

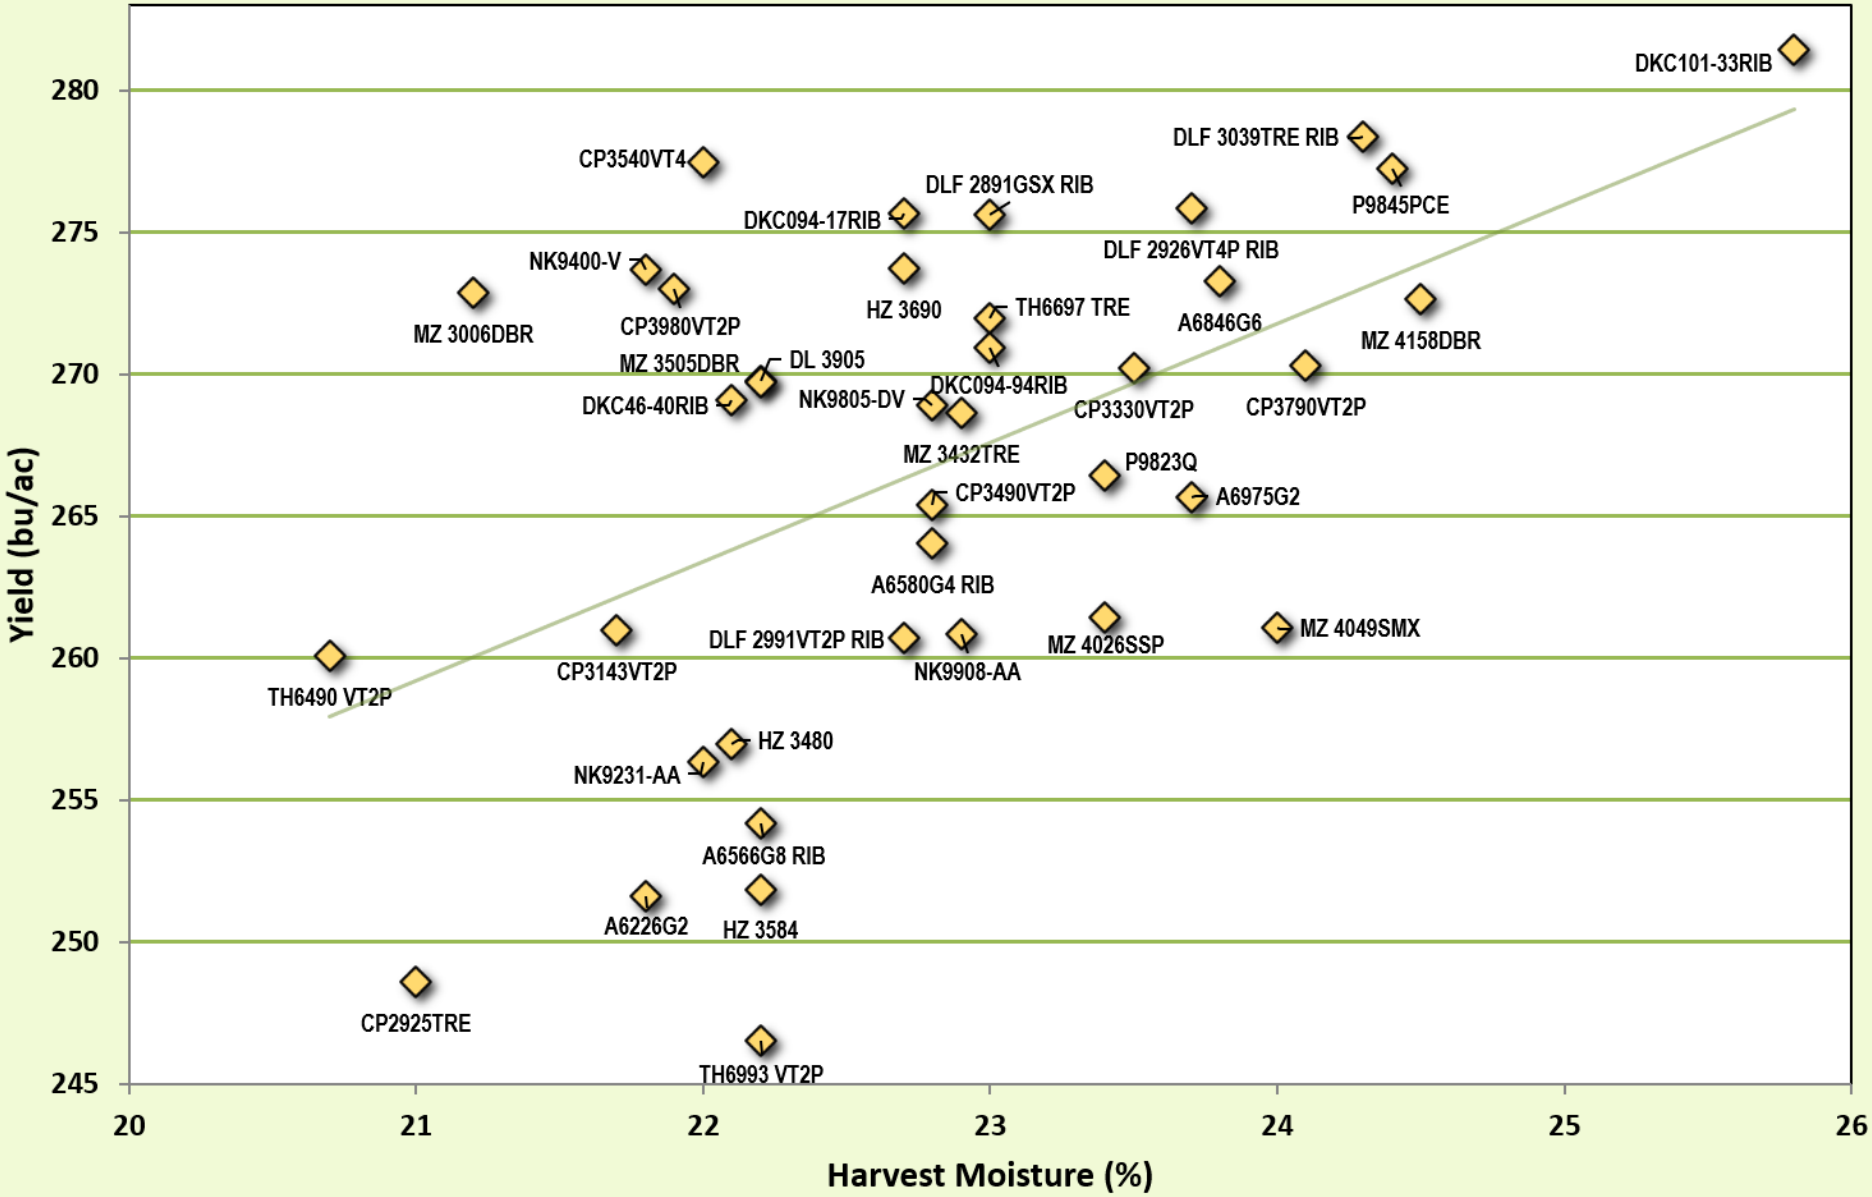

©2026 Ontario Corn Committee

Please refer to Table 3W for hybrid brand and complete agronomic performance data.

Average of 5 tests conducted in Blyth, Port Hope, Waterloo

Table 4: Exeter, Ilderton, Woodstock, Belmont **2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee**

					2025-2026 averages[1]				2026 averages[2]				Results of 2026 Performance Trials											
					average of 7 trials				average of 4 trials				BELMONT			EXETER			ILDERTON			WOODSTOCK		
CHU	Brand and/or Hybrid		GM Trait	Seed Trt	Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Test Wt Index	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %	Yield Index	Moist %	Ldg %
2800	CROPLAN	CP3330VT2P	6	A	**99**	**24.7**	**0**	**101**	**97**	**22.6**	**0**	**101**	101	22.2	0	94	24.6	0	96	23.0	0	97	20.5	0
2800	CROPLAN	CP3540VT4	39	A	**99**	**22.0**	**0**	**105**	**97**	**20.9**	**0**	**105**	100	21.1	0	93	21.3	0	89	21.7	0	104	19.5	0
2850	CROPLAN	CP3490VT2P	6	A	**94**	**23.9**	**0**	**101**	**90**	**21.9**	**0**	**102**	85	20.9	0	91	23.0	0	91	24.0	0	94	19.9	0
2850	De Dell	DL 3905	0	F	**99**	**22.7**	**0**	**102**	**97**	**20.8**	**0**	**103**	89	20.6	0	97	21.8	0	93	21.8	0	109	19.2	0
2875	PRIDE Seeds	A6580G4 RIB	32	F					**95**	**21.6**	**0**	**104**	97	22.0	0	94	21.3	0	92	23.0	0	98	20.2	0
2875	PRIDE Seeds	A6677G4 RIB	32	F					**98**	**22.2**	**0**	**100**	90	22.5	0	107	22.7	0	100	23.6	0	96	20.1	0
2900	Maizex	MZ 3751TRE	32	F					**98**	**22.1**	**0**	**100**	103	21.3	0	100	23.7	0	102	23.0	0	90	20.5	0
2925	CROPLAN	CP3790VT2P	6	A	**101**	**25.4**	**0**	**99**	**96**	**24.4**	**0**	**100**	104	22.5	0	93	26.4	1	96	26.7	0	92	21.9	0
2925	Maizex	MZ 3794TRE	38	F					**98**	**22.4**	**0**	**98**	88	23.0	0	99	22.8	1	99	23.3	0	107	20.5	0
2950	CROPLAN	CP3980VT2P	6	A	**99**	**23.3**	**0**	**102**	**100**	**22.4**	**0**	**102**	99	22.4	0	96	23.1	0	101	23.7	0	103	20.2	0
2950	Maizex	MZ 4026SSP	38	F	**101**	**25.1**	**0**	**101**	**103**	**23.6**	**0**	**103**	105	23.7	0	104	24.8	0	97	25.1	0	103	20.9	0
2950	PRIDE Seeds	A6846G6	38	P	**95**	**24.9**	**0**	**100**	**93**	**23.3**	**0**	**101**	85	22.3	0	90	22.8	0	98	27.9	0	102	20.2	0
2975	De Dell	DL 4910	0	-	**95**	**22.9**	**0**	**104**	**94**	**21.6**	**0**	**105**	97	22.8	0	95	21.5	0	87	22.4	0	95	19.9	0
2975	NK Brand	NK0001-DS	41	F																		88	19.7	0
2975	NK Brand	NK9908-AA	28	F	**99**	**24.4**	**0**	**101**	**100**	**23.3**	**0**	**101**	103	23.0	0	101	25.0	0	97	24.7	0	98	20.7	0
2975	PRIDE Seeds	A6975G2	6	F	**102**	**24.0**	**0**	**101**	**99**	**22.1**	**0**	**102**	104	23.8	0	95	22.2	1	97	22.2	0	98	20.1	0
3000	De Dell	DL 5021	0	F					**102**	**22.7**	**0**	**103**	101	23.9	0	101	22.9	0	96	23.5	0	110	20.7	0
3000	DLF	DLF 3039TRE RIB	32	AD	**99**	**26.5**	**0**	**99**	**96**	**24.9**	**0**	**100**	104	23.7	0	100	26.8	0	98	27.8	0	85	21.5	1
3000	Pioneer	P01851V	40	L					**104**	**24.9**	**0**	**100**	109	24.1	0	104	25.2	0	106	28.3	0	98	22.0	0
3025	DEKALB	DKC100-01RIB	39	A	**103**	**24.9**	**0**	**99**	**105**	**22.4**	**0**	**101**	107	21.6	0	103	23.0	0	105	24.8	0	105	20.3	1
3050	CROPLAN	CP4124VT4	39	A					**94**	**23.6**	**0**	**100**	84	23.3	0	99	25.2	0	99	24.3	0	97	21.5	0
3050	DEKALB	DKC099-59RIB	38	A	**102**	**26.2**	**0**	**98**	**102**	**25.0**	**0**	**99**	90	23.1	0	110	27.0	0	106	29.3	0	104	20.7	0
3075	DEKALB	DKC101-33RIB	38	A	**107**	**27.2**	**0**	**96**	**107**	**26.3**	**0**	**97**	106	24.4	0	105	30.2	0	114	29.5	0	105	21.1	0

Table 4: Exeter, Ilderton, Woodstock, Belmont **2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee**

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 7 trials Yield Index	Moist %	Ldg %	Test Wt Index	2026 averages[2] average of 4 trials Yield Index	Moist %	Ldg %	Test Wt Index	Results of 2026 Performance Trials BELMONT Yield Index	Moist %	Ldg %	EXETER Yield Index	Moist %	Ldg %	ILDERTON Yield Index	Moist %	Ldg %	WOODSTOCK Yield Index	Moist %	Ldg %
3100	CROPLAN	CP4233TRE	32	A					**98**	**24.3**	**0**	**100**	95	25.0	0	102	25.8	0	97	24.9	0	99	21.6	0
3100	CROPLAN	CP4377TRE	32	A	**100**	**25.6**	**0**	**98**	**100**	**24.0**	**0**	**99**	99	23.0	0	100	26.6	0	108	25.4	0	94	20.9	0
3100	DEKALB	DKC102-19RIB	38	P					**103**	**25.5**	**0**	**97**	103	24.6	0	106	28.6	0	106	27.4	0	100	21.5	0
3100	Horizon	HZ 4373	34	F					**95**	**25.0**	**0**	**97**	98	23.8	0	100	27.4	0	99	26.4	0	85	22.3	0
3100	Maizex	MZ 4158DBR	6	F	**100**	**25.0**	**0**	**100**	**99**	**23.3**	**0**	**101**	101	23.0	0	95	24.4	1	103	24.9	0	99	21.0	0
3100	NK Brand	NK0252-D	33	F	**99**	**26.8**	**0**	**99**	**100**	**24.7**	**0**	**100**	102	24.7	0	97	25.9	0	96	26.6	0	103	21.4	0
3100	Pioneer	P03115V	40	L					**96**	**26.3**	**0**	**98**	90	25.9	0	100	28.3	0	101	29.1	0	95	22.0	0
3125	DEKALB	DKC103-93RIB	39	A	**105**	**27.0**	**1**	**96**	**108**	**26.0**	**0**	**96**	104	23.9	0	109	27.9	0	106	31.3	0	113	20.7	0
3125	Maizex	MZ 4310SSP	38	F					**101**	**24.1**	**0**	**97**	98	23.6	0	111	24.7	0	101	27.5	0	98	20.6	0
3125	NK Brand	NK0415-AA	28	F	**101**	**26.0**	**0**	**101**	**100**	**24.7**	**0**	**103**	101	23.7	0	99	25.0	0	99	28.3	0	101	21.7	1
3150	Pioneer	P0529Q	36	L	**100**	**27.2**	**0**	**99**	**102**	**26.4**	**0**	**100**	101	26.3	0	98	27.8	0	106	29.0	0	103	22.6	0
3175	DEKALB	DKC104-32RIB	6	P					**104**	**26.4**	**0**	**98**	105	24.8	0	103	29.2	0	104	29.3	0	104	22.4	0
3175	PRIDE Seeds	A7275G2	6	F	**102**	**25.8**	**0**	**99**	**102**	**23.6**	**0**	**100**	103	24.0	0	98	24.0	1	102	25.7	0	106	20.8	0
3175	PRIDE Seeds	A7474G6 RIB	39	F					**103**	**25.2**	**0**	**96**	106	23.9	0	99	27.5	0	104	27.5	0	104	22.0	0
3200	CROPLAN	CP4689PCE	30	A					**111**	**28.2**	**0**	**99**	111	25.4	0	109	31.9	0	113	32.6	0	110	23.0	0
3200	Maizex	MZ 4552SSP	38	F					**101**	**27.0**	**0**	**97**	107	25.0	0	99	32.1	0	103	29.0	0	94	21.9	0
3200	Maizex	MZ 4608SMX	8	F	**99**	**26.5**	**0**	**98**	**102**	**24.1**	**0**	**100**	98	23.6	0	102	25.1	0	103	26.0	0	106	21.5	0
3250	Pioneer	P07147PCE	30	L					**105**	**29.4**	**0**	**97**	115	28.4	0	102	32.7	1	96	32.3	0	104	24.2	0
3250	Pioneer	P0720Q	36	L					**103**	**28.1**	**0**	**99**	111	26.6	0	102	31.1	0	94	31.9	0	103	22.6	0
	LSD (0.10) for Yield Index Points*				**4**				**5**				10			11			10			12		
	Average all hybrids **				**244**	**25.1**	**0**	**68**	**242**	**24.2**	**0**	**67**	268	23.6	0	232	25.7	0	193	26.3	0	275	21.1	0

[1] Belmont 2025-2026, Exeter 2025-2026, Ilderton 2026, Woodstock 2025-2026 [2] Belmont, Exeter, Ilderton, Woodstock


* The LSD is a measure of variability within the trial. Yield indices that differ by an amount less than or equal to the LSD should be considered to be equal.

** Average Yields are shown in bushels per acre. Average Test Weights are shown in kg/hl.

Hybrid selection should be based on the most data available. Emphasis should be put on averages from several locations and years because these provide a more accurate prediction of future performance than do single location results.

Note: The accuracy of moisture measurement decreases as moisture content increases. This also affects the accuracy of yield determination. Results for hybrids with moisture contents over 30% should be interpreted with much caution.

OCC 1 Year Averages (2026) for Area 4: Exeter, Ilderton, Woodstock, Belmont.

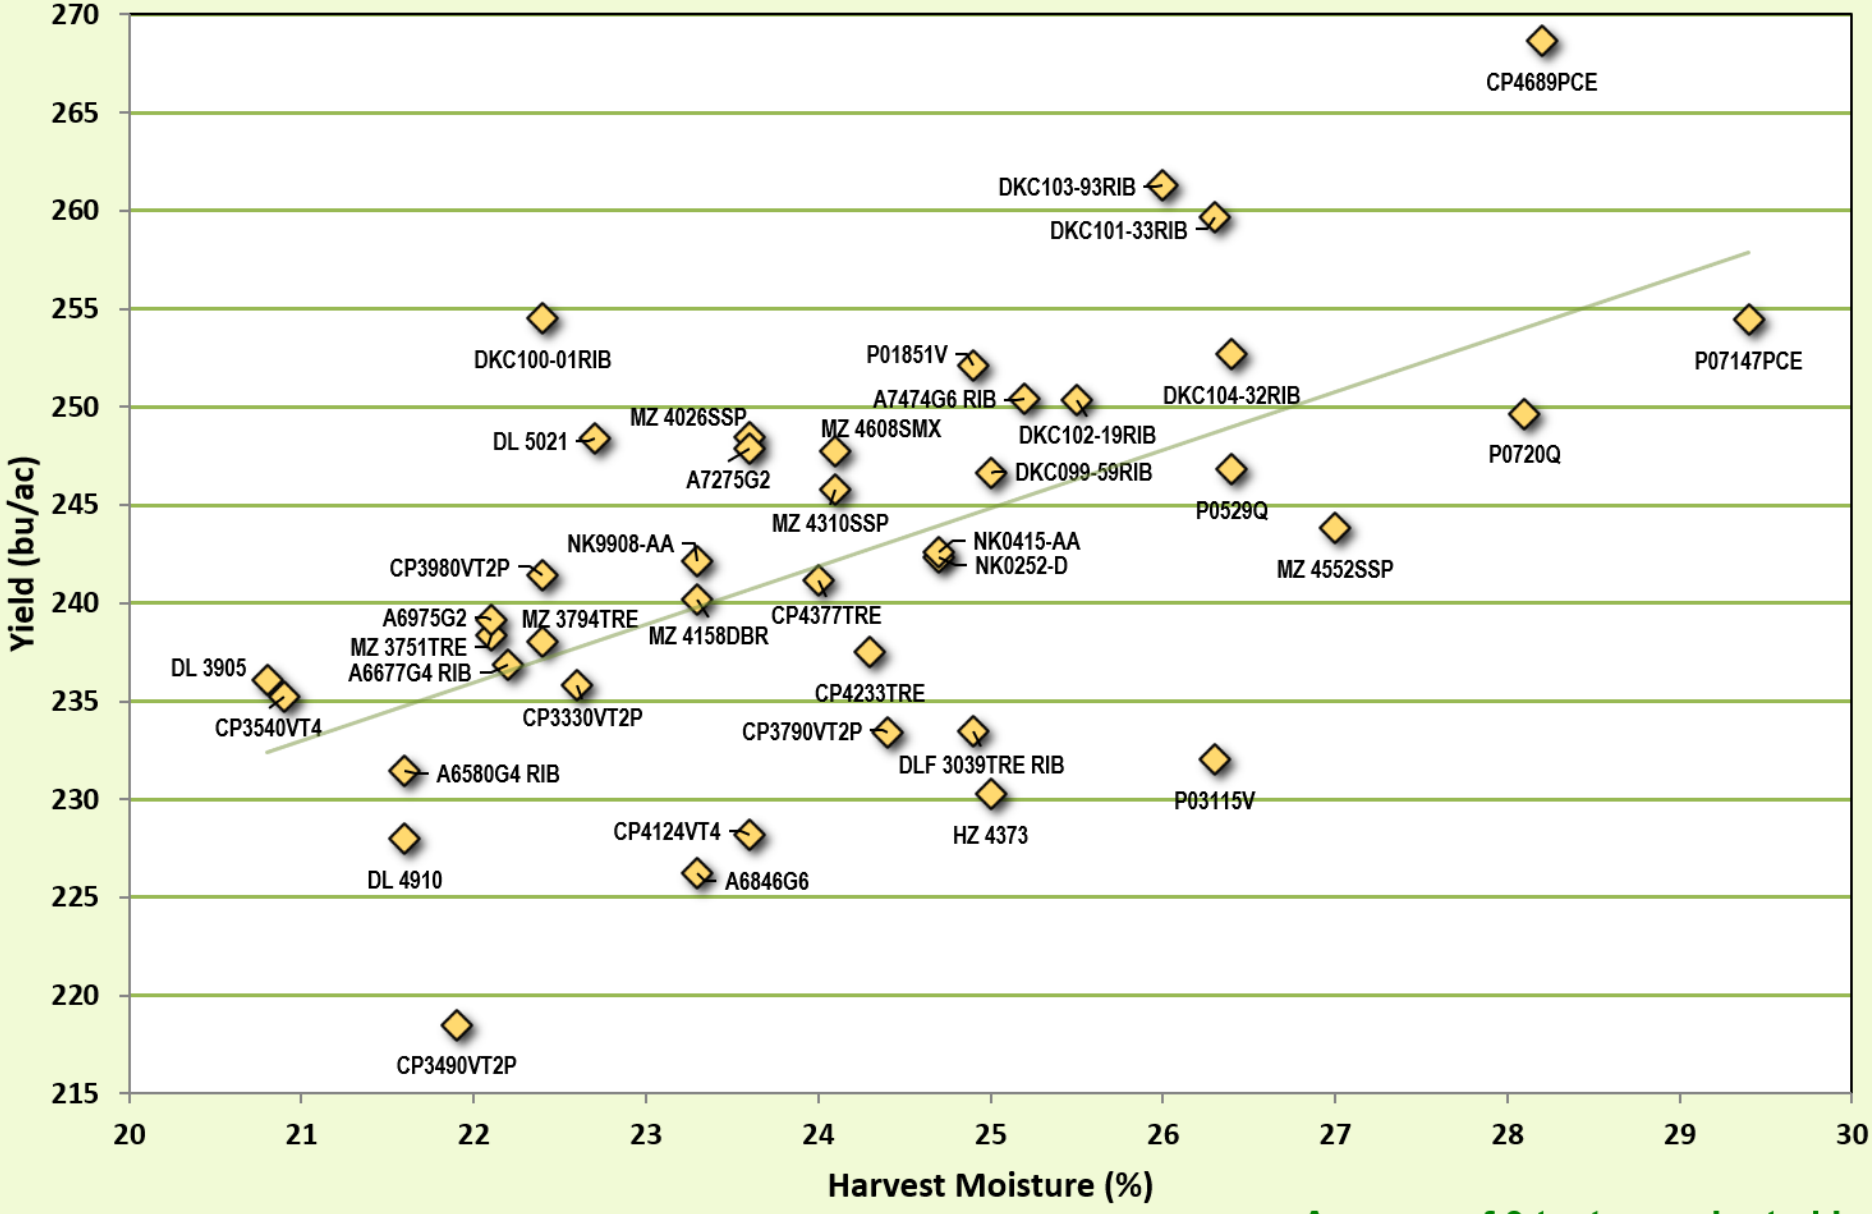


©2026 Ontario Corn Committee

Please refer to Table 4 for hybrid brand and complete agronomic performance data.

Average of 3 tests conducted in Exeter, Woodstock, Belmont

OCC 2 Year Averages (2025-2026) for Area 4: Exeter, Ilderton, Woodstock, Belmont.

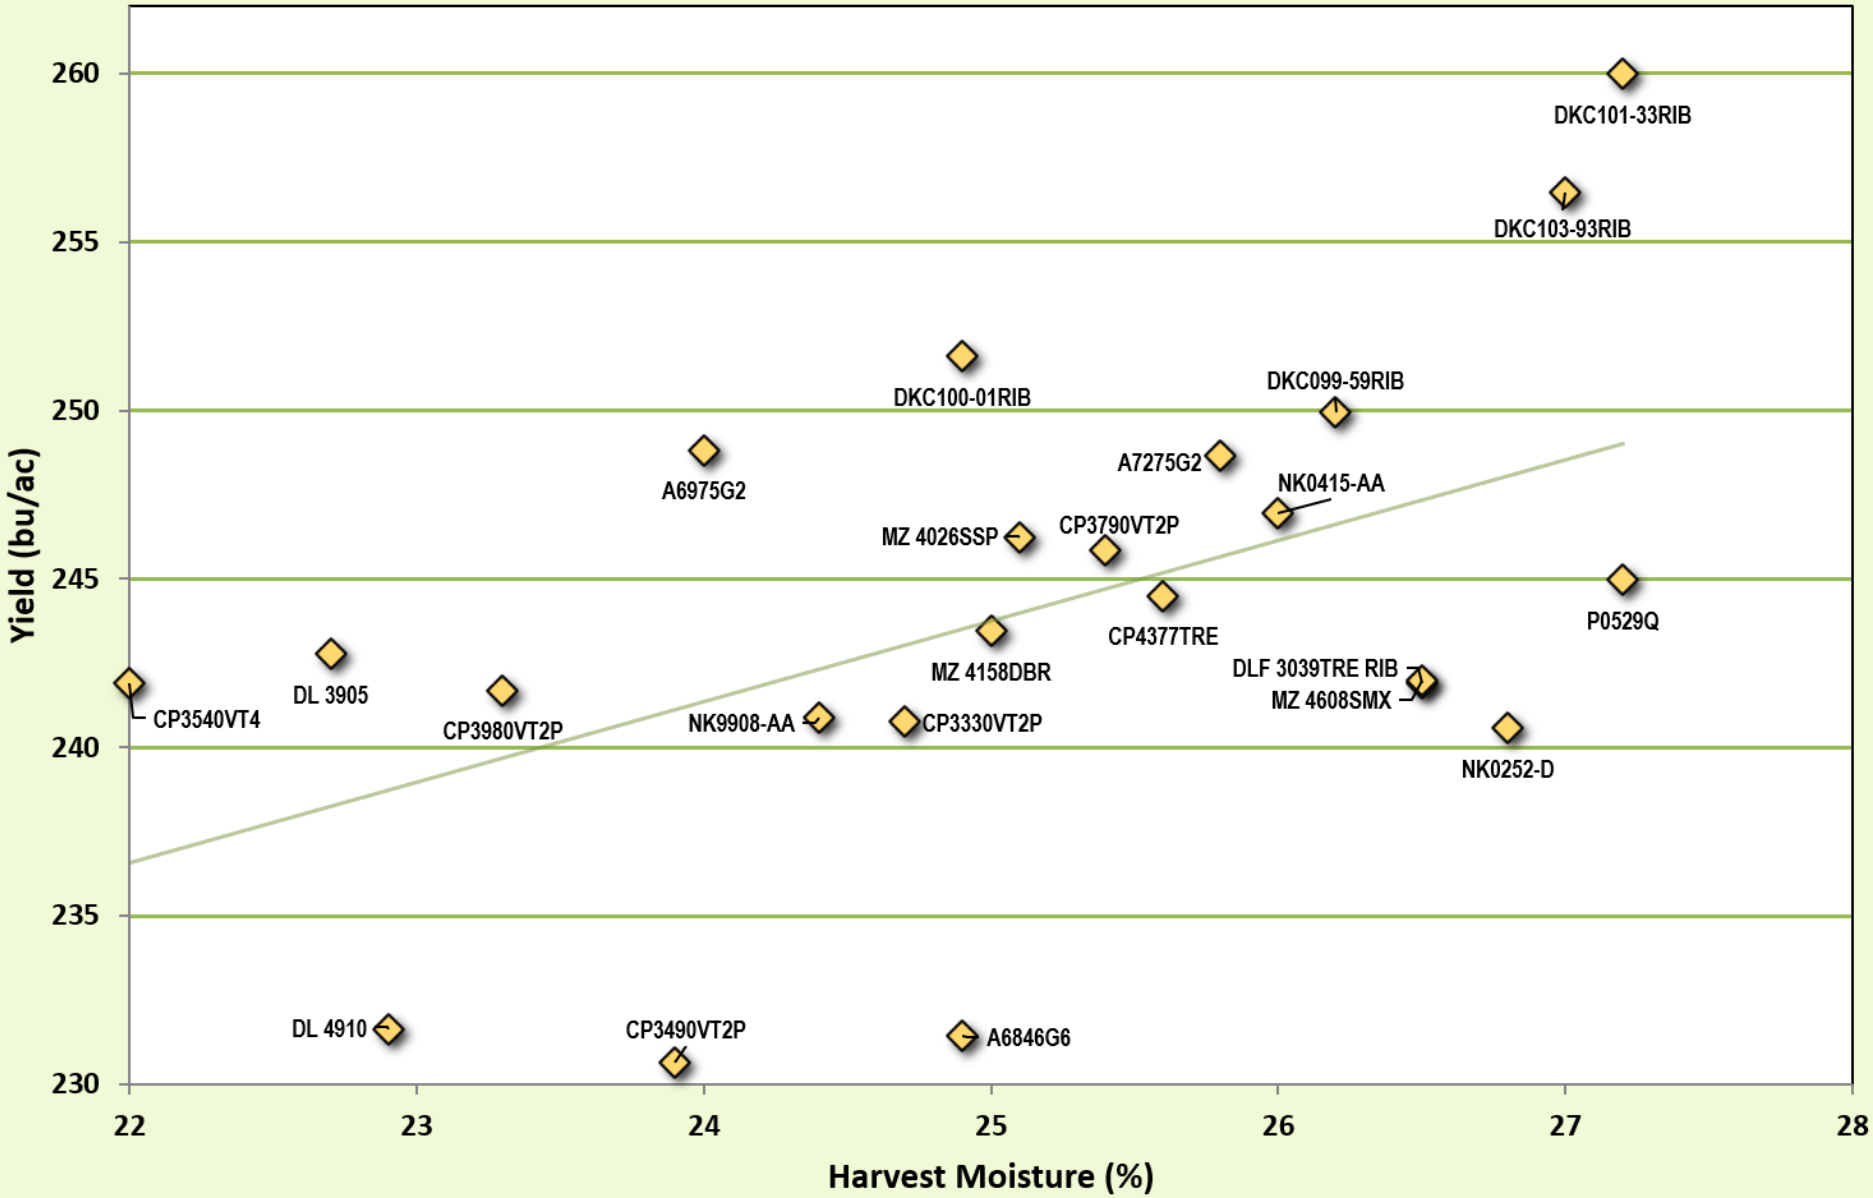

©2026 Ontario Corn Committee

Please refer to Table 4 for hybrid brand and complete agronomic performance data.

Average of 6 tests conducted in Exeter, Ilderton, Woodstock, Belmont

Table 5: Ridgetown, Tilbury, Dresden **2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee**

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 6 trials Yield Index	Moist %	Ldg %	Test Wt Index	2026 averages[2] average of 3 trials Yield Index	Moist %	Ldg %	Test Wt Index	Results of 2026 Performance Trials DRESDEN Yield Index	Moist %	Ldg %	RIDGETOWN Yield Index	Moist %	Ldg %	TILBURY Yield Index	Moist %	Ldg %
3050	CROPLAN	CP4124VT4	39	A					**91**	**19.3**	**0**	**100**	94	16.8	0	83	19.7	0	98	21.6	0
3100	CROPLAN	CP4233TRE	32	A					**96**	**20.0**	**0**	**100**	98	18.1	0	96	19.8	0	93	22.1	0
3100	CROPLAN	CP4377TRE	32	A	**92**	**19.1**	**0**	**98**	**92**	**19.3**	**0**	**99**	91	17.0	0	88	19.8	0	97	21.0	0
3100	Maizex	MZ 4158DBR	6	F	**95**	**18.8**	**0**	**101**	**93**	**19.2**	**0**	**102**	99	17.1	0	91	19.2	0	90	21.1	0
3100	NK Brand	NK0252-D	33	F	**92**	**20.2**	**0**	**100**	**96**	**20.4**	**0**	**102**	98	17.5	0	94	20.9	0	96	22.8	0
3125	DEKALB	DKC103-93RIB	39	A	**104**	**20.5**	**1**	**97**	**107**	**19.9**	**0**	**98**	100	18.5	0	110	19.5	0	109	21.7	0
3125	Maizex	MZ 4310SSP	38	F					**99**	**19.5**	**0**	**99**	100	17.2	0	101	19.1	0	95	22.1	0
3125	NK Brand	NK0415-AA	28	F	**93**	**19.5**	**0**	**104**	**92**	**19.5**	**0**	**104**	86	16.6	0	95	19.8	0	96	22.0	0
3150	CROPLAN	CP4516TRE	32	A	**97**	**20.4**	**0**	**97**	**95**	**20.3**	**0**	**98**	92	17.4	0	99	20.0	0	94	23.7	0
3175	DEKALB	DKC104-32RIB	6	P					**105**	**19.8**	**0**	**100**	115	17.3	0	102	20.4	0	97	21.9	0
3175	PRIDE Seeds	A7275G2	6	F					**95**	**19.6**	**0**	**100**	96	16.9	0	102	19.5	0	87	22.5	0
3175	PRIDE Seeds	A7474G6 RIB	39	F					**98**	**19.4**	**0**	**97**	102	16.6	0	97	19.5	0	96	22.1	0
3200	CROPLAN	CP4689PCE	30	A					**105**	**21.2**	**0**	**99**	109	17.8	0	102	21.3	0	105	24.6	0
3200	CROPLAN	CP4757VT2P	6	A	**98**	**19.9**	**0**	**102**	**98**	**19.9**	**0**	**102**	107	17.5	0	99	20.2	0	89	21.9	0
3200	DEKALB	DKC107-84RIB	38	A	**100**	**21.1**	**0**	**100**	**101**	**21.0**	**0**	**101**	95	18.0	0	105	20.8	0	101	24.0	0
3200	DEKALB	DKC56-26RIB	32	A	**104**	**20.7**	**0**	**99**	**106**	**20.6**	**0**	**100**	111	18.1	0	106	20.0	0	102	23.6	0
3200	Maizex	MZ 4552SSP	38	F					**94**	**20.2**	**0**	**99**	93	17.0	0	91	21.0	0	96	22.5	0
3200	Maizex	MZ 4608SMX	8	F	**96**	**19.6**	**0**	**100**	**94**	**19.7**	**0**	**101**	95	17.6	0	96	19.8	0	89	21.7	0

Table 5: Ridgetown, Tilbury, Dresden

2026 Ontario Hybrid Corn Performance Trials - Conducted by the Ontario Corn Committee

CHU	Brand and/or Hybrid		GM Trait	Seed Trt	2025-2026 averages[1] average of 6 trials Yield Index	Moist %	Ldg %	Test Wt Index	2026 averages[2] average of 3 trials Yield Index	Moist %	Ldg %	Test Wt Index	Results of 2026 Performance Trials DRESDEN Yield Index	Moist %	Ldg %	RIDGETOWN Yield Index	Moist %	Ldg %	TILBURY Yield Index	Moist %	Ldg %
3225	NK Brand	NK0880-V	27	F	**106**	**22.0**	**0**	**99**	**108**	**21.8**	**0**	**98**	111	17.1	0	103	22.1	0	109	26.1	0
3225	PRIDE Seeds	A7780G4 RIB	32	F					**110**	**21.3**	**0**	**98**	107	17.1	0	110	21.6	0	114	25.1	0
3250	Maizex	MZ 4703DBR	6	F	**104**	**21.8**	**0**	**101**	**101**	**22.2**	**0**	**101**	89	19.6	0	99	22.0	0	113	24.9	0
3250	Maizex	MZ 4799SMX	8	F	**99**	**20.0**	**0**	**100**	**103**	**20.0**	**0**	**101**	107	17.1	0	101	20.8	0	99	22.0	0
3250	Pioneer	P07147PCE	30	L					**106**	**21.4**	**0**	**97**	108	18.1	0	106	21.2	0	103	24.7	0
3250	Pioneer	P0720Q	36	L	**104**	**21.3**	**0**	**100**	**102**	**21.3**	**0**	**100**	107	18.4	0	102	21.6	0	96	24.0	0
3250	PRIDE Seeds	A7388G8 RIB	8	F	**98**	**20.1**	**0**	**101**	**95**	**19.9**	**0**	**102**	85	16.8	0	103	20.6	0	95	22.2	0
3300	DEKALB	DKC110-10RIB	8	A	**106**	**22.5**	**1**	**100**	**109**	**22.0**	**0**	**101**	103	18.6	0	104	21.8	0	119	25.6	0
3300	Maizex	MZ 4824TRE	32	F					**101**	**21.5**	**0**	**102**	100	19.5	0	100	20.9	0	103	24.0	0
3375	DEKALB	DKC114-42RIB	38	A	**105**	**23.1**	**0**	**101**	**105**	**22.8**	**0**	**100**	103	20.8	0	103	23.0	0	110	24.6	0
3400	Pioneer	P1136AM	25	L	**104**	**22.8**	**0**	**100**	**104**	**23.1**	**0**	**99**	98	19.6	0	109	23.2	0	106	26.5	0
3400	PRIDE Seeds	A8303G8 RIB	8	F			**0**				**0**		102	21.1	0			0	103	27.5	0
	LSD (0.10) for Yield Index Points*				**4**				**5**				12			5			9		
	Average all hybrids **				**262**	**20.8**	**0**	**71**	**252**	**20.5**	**0**	**71**	243	17.9	0	270	20.7	0	245	23.3	0

[1] Dresden 2025-2026, Ridgetown 2025-2026, Tilbury 2025-2026 [2] Dresden, Ridgetown, Tilbury


* The LSD is a measure of variability within the trial. Yield indices that differ by an amount less than or equal to the LSD should be considered to be equal.

** Average Yields are shown in bushels per acre. Average Test Weights are shown in kg/hl.

Hybrid selection should be based on the most data available. Emphasis should be put on averages from several locations and years because these provide a more accurate prediction of future performance than do single location results.

Note: The accuracy of moisture measurement decreases as moisture content increases. This also affects the accuracy of yield determination. Results for hybrids with moisture contents over 30% should be interpreted with much caution.

OCC 1 Year Averages (2026) for Area 5: Ridgetown, Tilbury, Dresden.

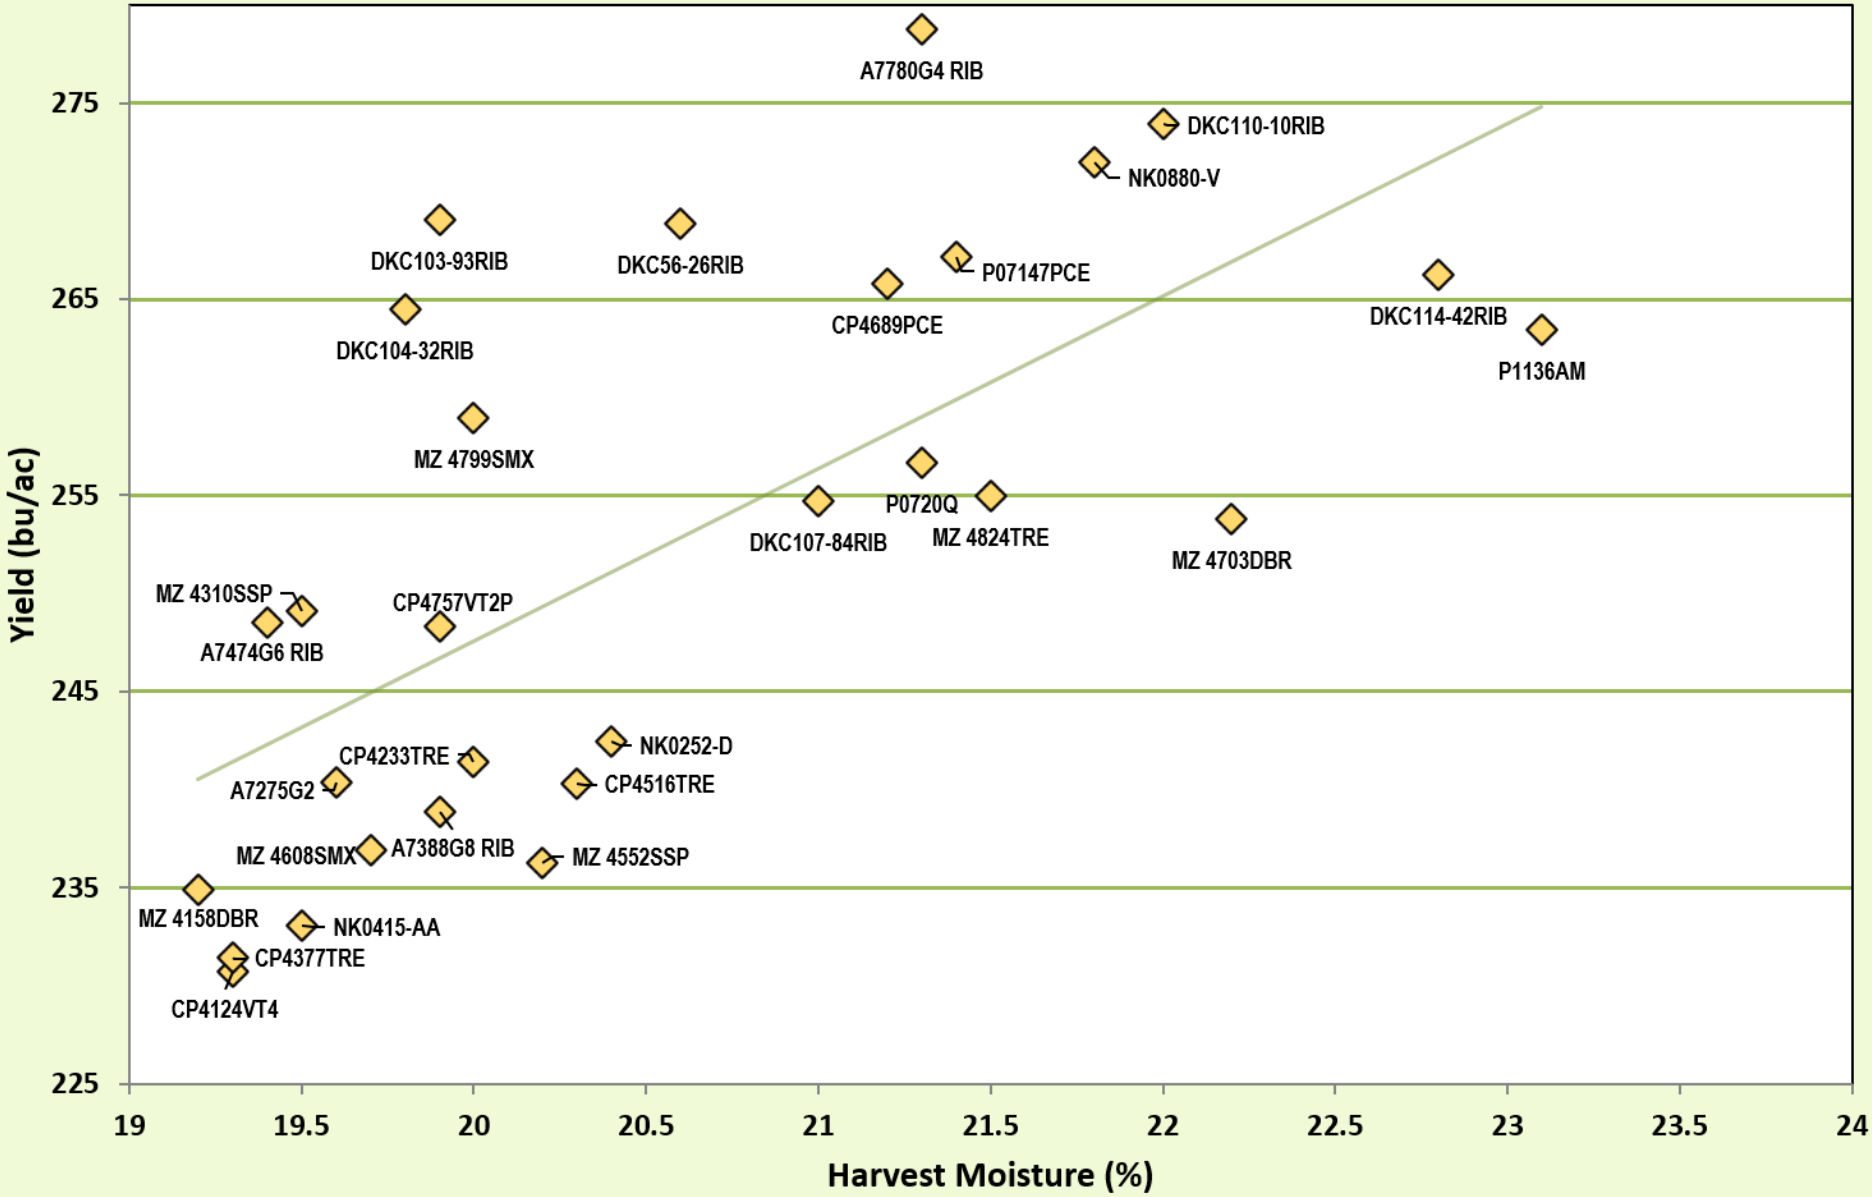


©2026 Ontario Corn Committee

Please refer to Table 5 for hybrid brand and complete agronomic performance data.

Average of 3 tests conducted in Ridgetown, Tilbury, Dresden

OCC 2 Year Averages (2025-2026) for Area 5: Ridgetown, Tilbury, Dresden.

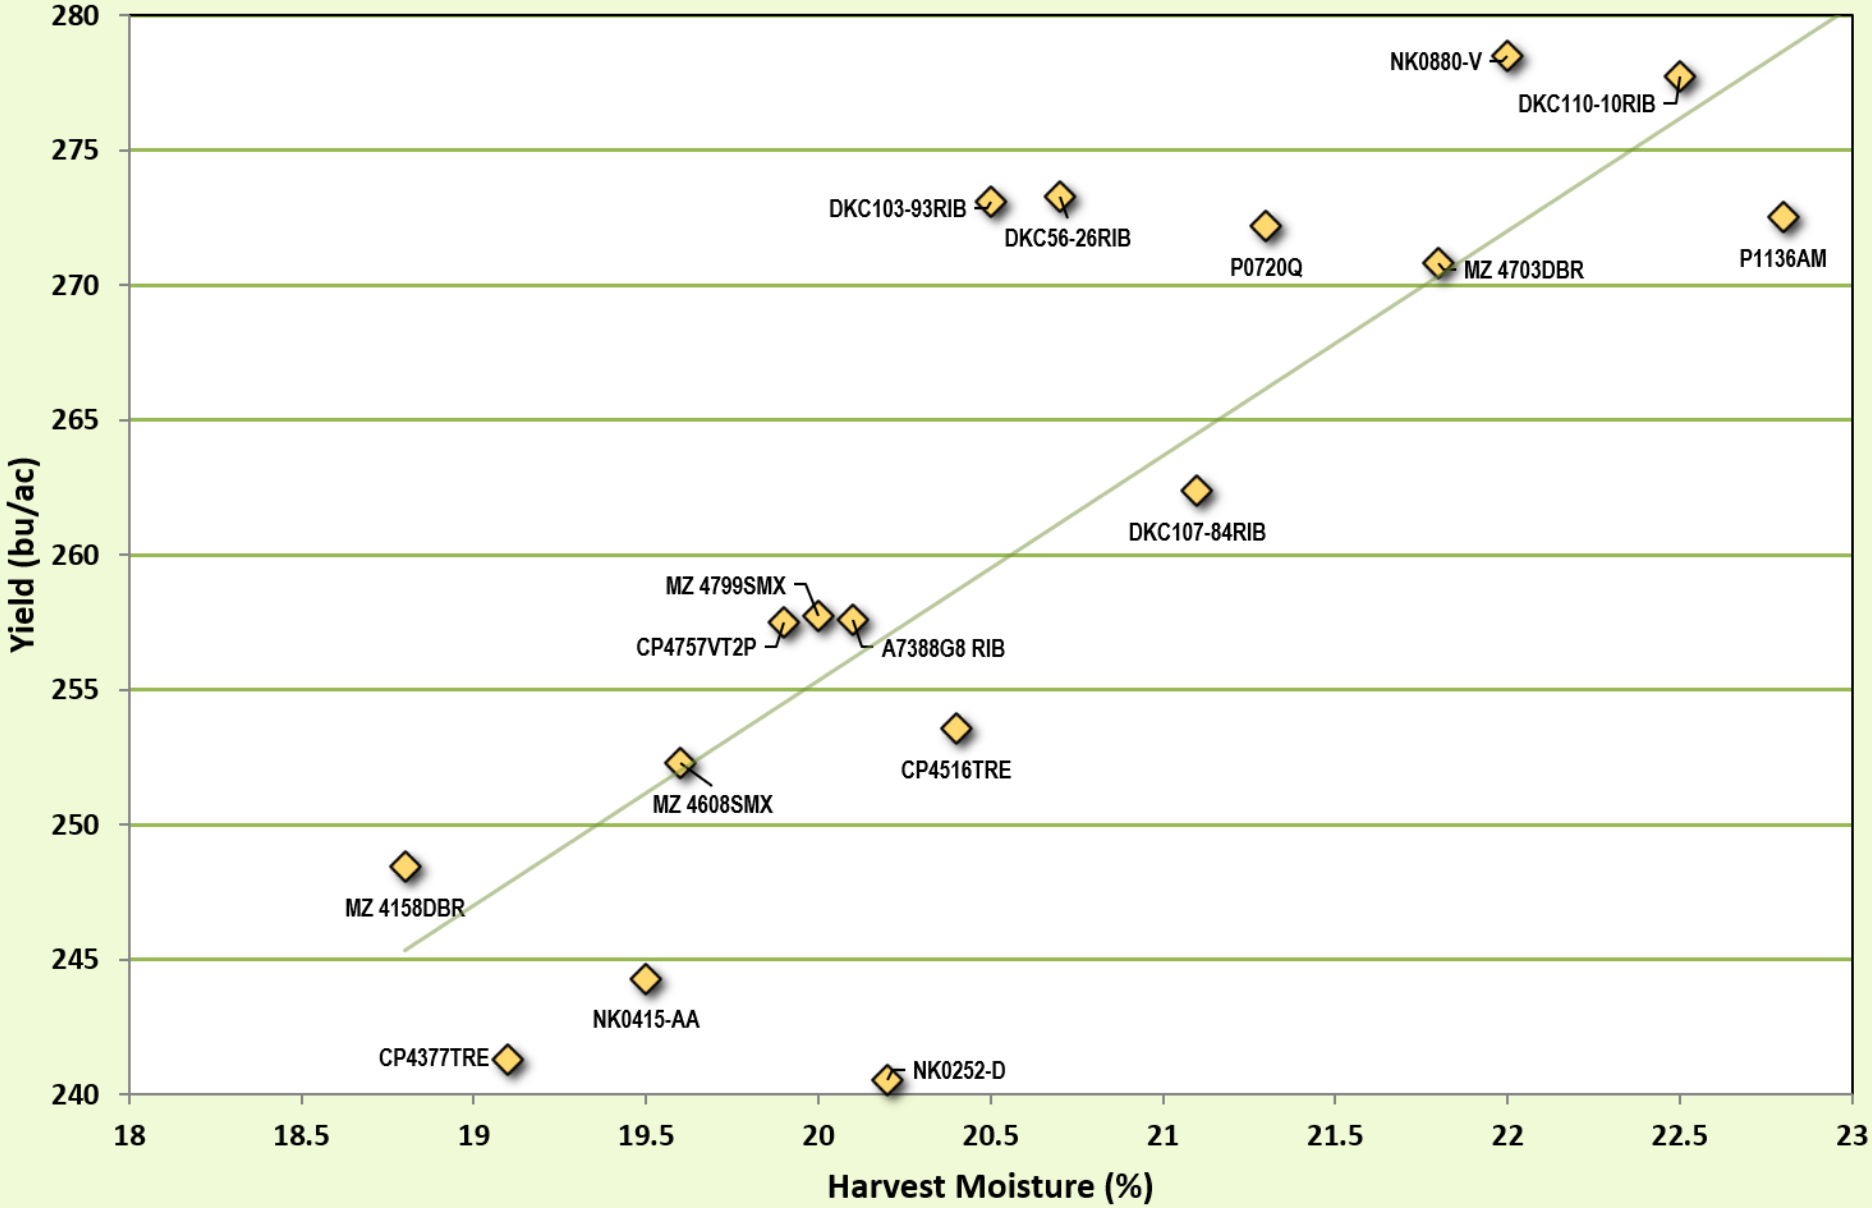

©2026 Ontario Corn Committee

Please refer to Table 5 for hybrid brand and complete agronomic performance data.

Average of 6 tests conducted in Ridgetown, Tilbury, Dresden